

Selection Guide ..... 242

Discrete Input Barriers ..... 244

    EB3C Discrete Input Barriers ..... 244

    EB3N Discrete Input Barrier..... 254

Discrete Output Barriers ..... 259

    EB3L Discrete Output Barriers ..... 259

Switches and Pilot Devices..... 267

General Information..... 273

Barriers





[www.IDEC.com/barriers](http://www.IDEC.com/barriers)




## Selection Guide

## Discrete Input Barrier

Model	EB3C-**AN	EB3C-**DN	EB3N-**D
Appearance			
Page	244		254
Ratings	UL: Class I, II, III Div1 / Group A, B, C, D, E, F, and G Class I, Zone 0 / [AExia] II C FM: Class I, II, III Div1 / Group A, B, C, D, E, F, and G Class I, Zone 0 / [AExia] II C PTB (ATEX): II(1)G [Exia] IIC: Gas vapor II(1) D[Exia] IIC: Dust PTB (IECEX): [Exia] IIC IEC Ex: [Exia] II C CQST: [Ex ia Ga] IIC TIIS: Discrete input barrier [Exia] IIC Switch (EB9Z-A) Exia IIC T6 Switch (EB9Z-A1) Exia IIB T6 NK: [Exia] II C KCs: [Exia] II C, [Exia D] KR: [Exia] IIC, [Exia] III C (pending)		UL: Class I, II, III, Div. 1, Groups A, B, C, D, E, F and G Class I, Zone 0, [AExia] II C PTB (IECEX): [Exia] II C PTB (ATEX): II (1) G [Exia] II C II (1) D [Exia D] CQST: [Exia] II C TIIS: [Exia] II C
Degree of Protection	IP20	IP20	IP20
Number of Channels	Relay Output: 1,2,3,5,6,8,10 Transistor Output: 1,2,3,5,6,8,10,16	Relay Output: 1,2,3,5,6,8,10 Transistor Output: 1,2,3,5,6,8,10,16	EB3N-□2ND: 2 safety circuits EB3N-□2R5D: 2 safety circuits, 5 auxiliary circuits
Power Voltage	100 to 240V AC (UL rating: 100- 120VAC)	24V DC	24V DC
Output	Relay Transistor (Sink/Source)	Relay Transistor (Sink/Source)	Relay
Connection	Screw Terminal	Screw Terminal, Connector	Screw Terminal
Mounting	35-mm-wide DIN rail Panel mounting	35-mm-wide DIN rail Panel mounting	35-mm-wide DIN rail / Panel mounting
Size (excluding projections)	42W×75H×77.5D (1 channel) 65W×75H×77.5D (2, 3 channels) 110.5W×75H×77.5D (5, 6, 8 channels (common)) 171.5W×75H×77.5D (8, 10 channels)	42W×75H×77.5D (1 channel) 65W×75H×77.5D (2, 3 channels) 110.5W×75H×77.5D (5, 6, 8 channels (common)) 171.5W×75H×77.5D (8, 10, 16 channels (common))	65.0W×75.0H×77.5D (EB3N-□2ND) 110.5W×75.0H×77.5D (EB3N-□2R5D)
Weight (approx.)	380g (EB3C-R10AN)	390g (EB3C-R16CDN)	220g (EB3N-□2ND) 300g (EB3N-□2R5D)

## Discrete Output Barrier

Model	EB3L-**-AN	EB3L-**-DN
Appearance		
Page	259	
Ratings	UL: Class I, II, III Div1 / Group A, B, C, D, E, F, and G Class I, Zone 0 / [AExia] II C FM: Class I, II, III Div1 / Group A, B, C, D, E, F, and G Class I, Zone 0 / [AExia] II C PTB (ATEX): II(1)G [Exia] IIC: Gas vapor II(1)D [Exia] IIIC: Dust PTB (IEC-Ex) [Exia] IIC [Exia] IIIC CQST: Ex ia Ga IEC Ex: [Exia] II C TIIS: Discrete output barrier [Exia] II C NK: [Exia] II C KCS: [Exia] II C, [Exia D] KR: [Exia] IIC, [Exia] III C (pending)	
Degree of Protection	IP20	IP20
Number of Channels	1, 2, 3, 5, 6, 8, 10	1, 2, 3, 5, 6, 8, 10, 16
Power Voltage	100 to 240V AC (UL rating: 100 ~ 120V AC)	24V DC
Input	Transistor input (sink) Transistor input (source)	Transistor input (sink) Transistor input (source)
Connection	Screw Terminal	Screw Terminal, Connector
Mounting	35-mm-wide DIN rail Panel mounting	35-mm-wide DIN rail Panel mounting
Size (excluding projections)	42W×75H×77.5D (1 channel) 65W×75H×77.5D (2, 3 channels) 110.5W×75H×77.5D (5, 6, 8 channels) 171.5W×75H×77.5D (8, 10 channels)	42W×75H×77.5D (1 channel) 65W×75H×77.5D (2, 3 channels) 110.5W×75H×77.5D (5, 6, 8 channels) 171.5W×75H×77.5D (8, 10, 16 channels (common))
Weight (approx.)	360g (EB3L-S10SAN)	360g (EB3L-S16CSDN)

## Switches and Pilot Lights



Page 267

**Pilot Light and Miniature Pilot Light**  
 IP65 (IEC60529) (except for terminals)  
 EB3P-LU/IPL1: IP40


**Illuminated Switch**  
 IP65 (IEC60529) (except for terminals)  
 EB3P-LSAW\*: IP54

**Buzzer**  
 IP20 (IEC60529) (except for terminals)

## Intrinsically Safe: EB3C Discrete Input Barriers

## Key features:

- Applicable Standards  
IEC60079 compliant  
Dry-contact switches can be connected to the EB3C
- 8- and 16-circuit types are available in common wiring types, ideal for connection to PLCs (DC voltage only)
- Universal AC power voltage (100 to 240V AC) or 24V DC power (UL rating: 100 ~ 120V AC)
- No grounding required
- IDEC's original spring-up terminals minimize wiring time
- Installation: 35-mm-wide DIN rail mounting or direct screw mounting
- Global usage  
USA: UL/FM  
Europe: CE marking,  
Global: IECEx ATEX  
Japan: TIIS  
China: CQST  
Korea: KCs  
Ship class: NK (Japan), KR (Korea pending)

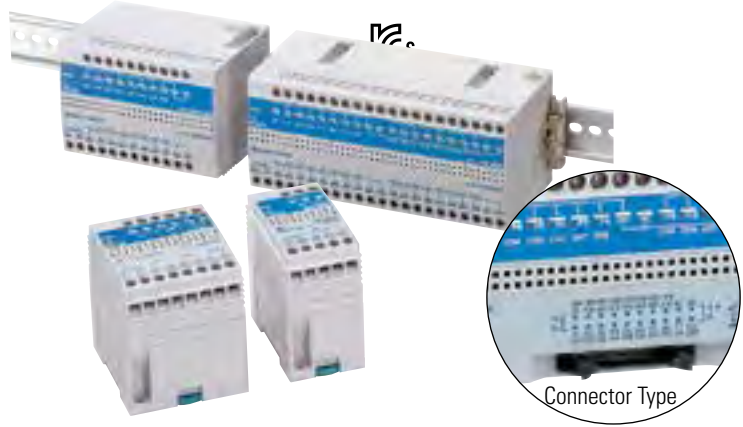

## Entity Barrier Parameters

Ta= 60°C, Um= 250V, (Um=125V UL only), Uo=13.2V, Io= 14.2mA, Po= 46.9mW at each channel  
Pn-Nn Io=227.2mA, Po= 750mW at max 16 channels Pn-Nn

Io(mA)	14.2	28.4	42.6	56.8	71.0	85.2	99.4	113.6	127.8	142.0	156.2	170.4	184.6	198.8	213.0	227.2	Combined
Po(mW)	46.9	93.8	140.6	187.5	234.3	281.2	328.1	375.9	421.8	468.7	515.5	562.4	609.2	656.1	702.9	750	Lo(mH)
Co(μF)	0.67	0.65	0.63	0.61	0.59	0.57	0.55	0.53	0.51	0.49	0.47	0.44	0.42	0.39	-	-	1.0
	0.79	0.77	0.76	0.75	0.73	0.72	0.70	0.69	0.67	0.66	0.64	0.62	0.61	0.59	0.57	0.55	0.5
	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.93	0.92	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.2
	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.1
Note 1 Added to above table, the next values combined Lo and Co are allowable;																	
Io(mA)	14.2					28.4					227.2						
Lo(mH)	175*	87.5	30.0	2.5	0.55	0.25	43.5*	21.5	20.0	3.5	0.43	0.25	0.68*	0.34	0.68	0.6	0.22
Co(μF)	0.90*	0.45	0.33	0.54	0.77	0.90	0.90*	0.45	0.30	0.48	0.80	0.90	0.90*	0.45	0.45	0.49	0.80

Note 2 The intrinsic safe apparatus and wirings shall be accordance to following formulas; for example:  $U_i \geq U_o$   $I_i \geq I_o$   $P_i \geq P_o$   $C_i + C_c \leq C_o$   $L_i + L_c \leq L_o$

\*: Therefore, the values are allowable only at  $L_i \leq 1\%L_o$  and  $C_i \leq 1\%C_o$  of the intrinsic safe apparatus. (In the case of 50% of  $C_o$  and  $L_o$  parameters are applicable, the maximum capacitance allowed shall not be more than  $C_o = 1 \mu F$  for IIB and  $C_o = 600 nF$  for IIC.)

TIIS, NK only  
Ta=60°C, Um=250V


	1 ch Seperate	16 ch Common 16
Uo	13.2V	13.2V
Io	14.2mA	227.2mA
Po	46.9mW	750mW
Co	0.47μF	0.365μF
Lo	87.5mH	0.425mH

## Dry Contact Switches

Dry-contact switches can be connected to the EB3C.



## Spring-up Fingersafe Terminals Reduce Wiring Time

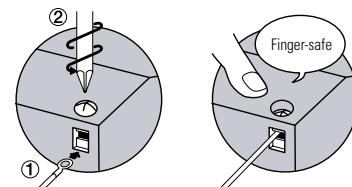

## Connector Type

MIL connector on the non-hazardous side

- Easy connection to PLCs
- Wiring reduced
- Various 20-pin MIL connectors can be connected

## Common Wiring for PLC Inputs

8- and 16-circuit types are available in common wiring types, ideal for connection to PLCs (DC voltage only).

## Specifications

## EB3C Electrical Specifications

Ratings		See Certification Numbers table below	
Degree of Protection		IP20 (IEC60529)	
Installation Location	Discrete Input Barrier	Safe indoor place (non-hazardous area)	
Non-intrinsically Safe Circuit Maximum Voltage (Um)		250V AC 50/60Hz, 250V DC 125V AC 50/60Hz, 125V DC (UL rating)	
Intrinsically Safe Circuits	Wiring Method	1-channel Separate Wiring	16-channel Common Wiring
	Rated Operating Voltage	12V DC $\pm 10\%$	
	Rated Operating Current	10 mA DC $\pm 20\%$	
Non-intrinsically Safe Circuits	Relay Output	Contact Configuration	1NO
		Rated Insulation Voltage (Ui)	250V AC (UL rating: 125V AC), 125V DC
		Thermal Current (Ith)	3A (common terminal: 8A)
		Contact Allowable Power	Resistive Load AC: 750 VA, DC: 72W
			Inductive Load AC: 750 VA ( $\cos \phi = 0.3$ to $0.4$ ) DC: 48W ( $L/R = 7$ ms)
		Rated Load	Resistive Load 250V AC 3A, 24V DC 3A
			Inductive Load 250V AC 3A ( $\cos \phi = 0.3$ to $0.4$ ) 24V DC 2A ( $L/R = 7$ ms)
		Minimum Applicable Load	0.1V DC, 0.1 mA (reference value)
		Contact Resistance	50 m $\Omega$ maximum (initial value)
		ON Time	12 ms maximum (rated voltage)
		OFF Time	10 ms maximum (rated voltage)
		Mechanical Life	20,000,000 operations minimum (at 18,000 operations/hour, without load)
		Electrical Life	100,000 operations minimum (at 1,800 operations/hour, rated load)
		Short-circuit Protection	None
	Transistor Output	Rated Voltage	24V DC
		Maximum Voltage	30V DC
		Maximum Current	100 mA (connector type: 15 mA)
		Leakage Current	0.1 mA maximum
		Voltage Drop	1.5V maximum
		Clamping Voltage	33V (1W)
		Inrush Current	0.5A maximum (1 sec)
		ON Time	0.1 ms maximum (resistive load)
		OFF Time	0.4 ms (typical) (resistive load)
		Short-circuit Protection	None

## EB3C General Specifications

	AC	DC
Rated Voltage	100 to 240V AC (UL rating: 100 ~ 120V AC)	24V DC
Allowable Voltage Range	85 to 264V AC (UL rating: 85 ~ 125V AC)	21.6 to 26.4V DC
Rated Frequency	50/60 Hz (allowable range: 47 to 63 Hz)	—
Inrush Current	10A (100V AC) 20A (200V AC)	10A

Dielectric Strength (1 minute, 1 mA)		Between intrinsically safe circuit and non-intrinsically safe circuit: 1526.4V AC Between AC power and output terminal: 1500V AC Between DC power and transistor output terminal: 1000V AC
Operating Temperature		-20 to +60°C (no freezing)
Storage Temperature		-20 to +60°C (no freezing)
Operating Humidity		45 to 85% RH (no condensation)
Atmosphere		800 to 1100 hPa
Pollution Degree		2 (IEC60664)
Insulation Resistance		10 M $\Omega$ minimum (500V DC megger, between the same poles as the dielectric strength)
Vibration Resistance	Damage Limits	Panel mounting: 10 to 55 Hz, amplitude 0.75 mm DIN rail mounting: 10 to 55 Hz, amplitude 0.35 mm
	Operation Extremes (relay output only)	Panel mounting: 10 to 55 Hz, amplitude 0.5 mm DIN rail mounting: 10 to 55 Hz, amplitude 0.35 mm
Shock Resistance	Damage Limits	Panel mounting: 500 m/s <sup>2</sup> (3 times each on X, Y, Z) DIN rail mounting: 300 m/s <sup>2</sup> (3 times each on X, Y, Z)
	Terminal Style	M3 screw terminal
Mounting		35-mm-wide DIN rail or panel mounting (M4 screw)
Power Consumption (approx.)		9.6 VA (EB3C-R10AN at 200V AC) 4.8 W (EB3C-R16CDN at 24V DC)
Weight (approx.)		390g (EB3C-R16CDN)

## EB3C Certification Numbers

Certification Organization	Ratings	Certification Number
UL	Class I, II, III Div. 1 Group A, B, C, D, E, F, and G Class I, Zone 0 / [AExia] II C	E234997
FM	Class I, II, III Div. 1 Group A, B, C, D, E, F, and G Class I, Zone 0 / [AExia] II C	3047250
PTB (ATEX)	II(1)G [Exia] II C: Gas Vapour, II(1)D [Exia] III C: Dust	PTB09 ATEX2046
PTB (IEC-EX)	[Exia] II C: Gas, Vapour [Exia] III C: Dust	IECEx PTB10.0015
TIIS Japan	Relay barrier: [Exia] II C Switch (EB9Z-A) : Exia II C T6 Switch (EB9Z-A1) : Exia II B T6	TC 20541 TC15758 TC15961
Class NK	[Exia] II C	TYPE TEST No. 13T606
CQST	[Exia Ga] II C	CNEx 14.0047
KCs	Relay Barrier : [Exia] II C	14-AV4B0-0373
KR	[Exia] IIC	Pending

Class NK is Japan Shipping agency approval, Class KR is Korean shipping agency approval.

OI Touchscreens

PLCs

Automation Software

Power Supplies

Sensors

Communication

Barriers

Part Numbers

OI Touchscreens  
PLCs  
Automation Software  
Power Supplies  
Sensors  
Communication

Discrete Input Barriers

Power Voltage	Connection to Non-intrinsically Safe Circuit	Input Wiring Method	Output		Number of Channels	Part Number	Weight (approx) g
100 to 240V AC (UL rating: 100 ~ 120V AC)	Screw Terminal	Separate/Common Wiring Compatible	Relay		1	EB3C-R01AN	150
					2	EB3C-R02AN	180
					3	EB3C-R03AN	190
					5	EB3C-R05AN	260
					6	EB3C-R06AN	270
					8	EB3C-R08AN	300
					10	EB3C-R10AN	380
					8	EB3C-R08CAN	280
		Separate/Common Wiring Compatible	Transistor (Sink/Source)		1	EB3C-T01AN	140
					2	EB3C-T02AN	170
					3	EB3C-T03AN	180
					5	EB3C-T05AN	250
					6	EB3C-T06AN	260
					8	EB3C-T08AN	320
					10	EB3C-T10AN	340
					Common Wiring Only	Transistor	Sink
16	EB3C-T16CKAN	260					
Source	8	EB3C-T08CSAN	260				
	16	EB3C-T16CSAN	260				
24V DC	Screw Terminal	Separate/Common Wiring Compatible	Relay		1	EB3C-R01DN	130
					2	EB3C-R02DN	170
					3	EB3C-R03DN	180
					5	EB3C-R05DN	250
					6	EB3C-R06DN	260
					8	EB3C-R08DN	260
					10	EB3C-R10DN	360
					8	EB3C-R08CDN	270
					16	EB3C-R16CDN	390
					Separate/Common Wiring Compatible	Transistor (Sink/Source)	
		2	EB3C-T02DN	160			
		3	EB3C-T03DN	170			
		5	EB3C-T05DN	240			
		6	EB3C-T06DN	250			
		8	EB3C-T08DN	250			
		10	EB3C-T10DN	320			
		Common Wiring Only	Transistor	Sink			
				16	EB3C-T16CKDN	350	
	Source			8	EB3C-T08CSDN	250	
	16			EB3C-T16CSDN	350		
Connector	Common Wiring			Sink	16	EB3C-T16CKD-CN	330
				Source		EB3C-T16CSD-CN	330

Accessories


Item	Part Number	Description
DIN Rail	BAP1000	Steel (1m long, 7.5mm high)
	BAA1000	Aluminum (1m long, 10.5mm high)
End Clip	BNL6	Medium DIN rail end clip
Static Electricity Caution Plate	EB9Z-N1	Polyester 20 (W) x 6 (H) mm

Barriers


## Circuit Diagrams

## Internal Circuit Block Diagrams


AC Power, Relay Output Type

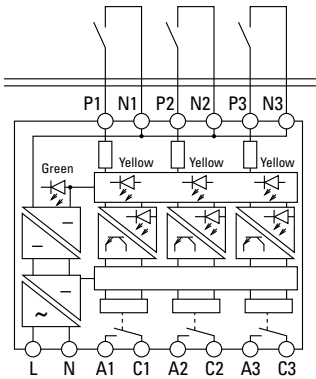

DC Power, Transistor Output Type

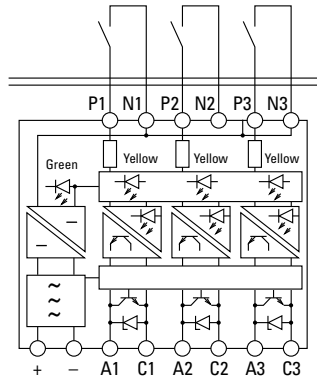


Connector Wiring, Sink Output Type

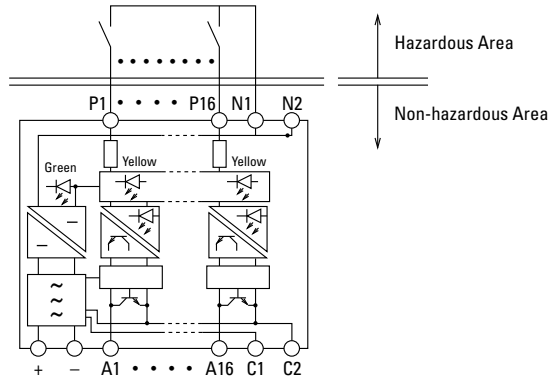

## Wiring Examples


## External Wiring Examples

Transistor Output Type (Ex.: EB3C-T06AN)

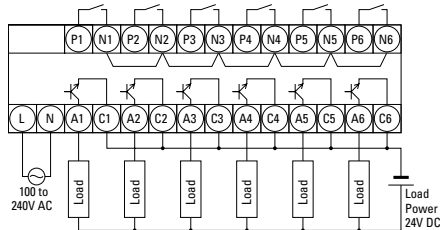


Note: On the sink/source transistor output type, terminals A can be used as a positive common line.


Transistor Sink Output Type (Ex.: EB3C-T08CKDN)

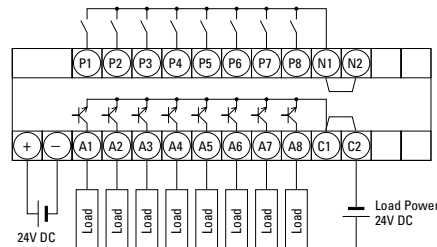


Transistor Source Output Type (Ex.: EB3C-T08CSDN)

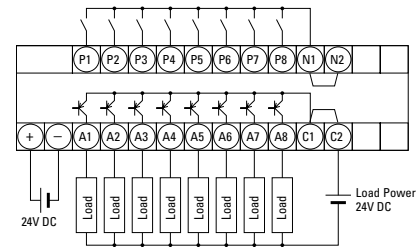

Relay Output Type (Ex.: EB3C-R06AN)

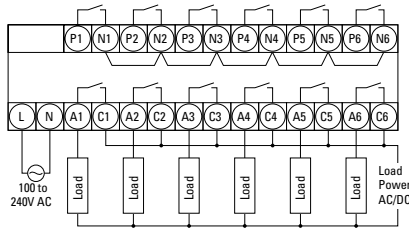


Relay Output Common Wiring Type (Ex.: EB3C-R016CDN)

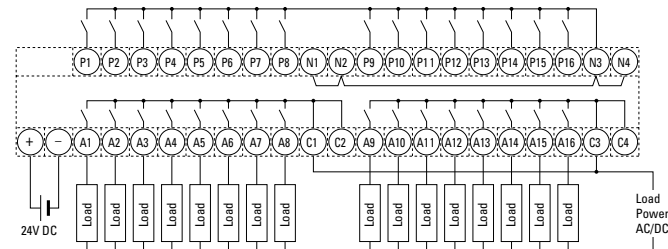


## Dimensions (mm)


## Screw Terminal

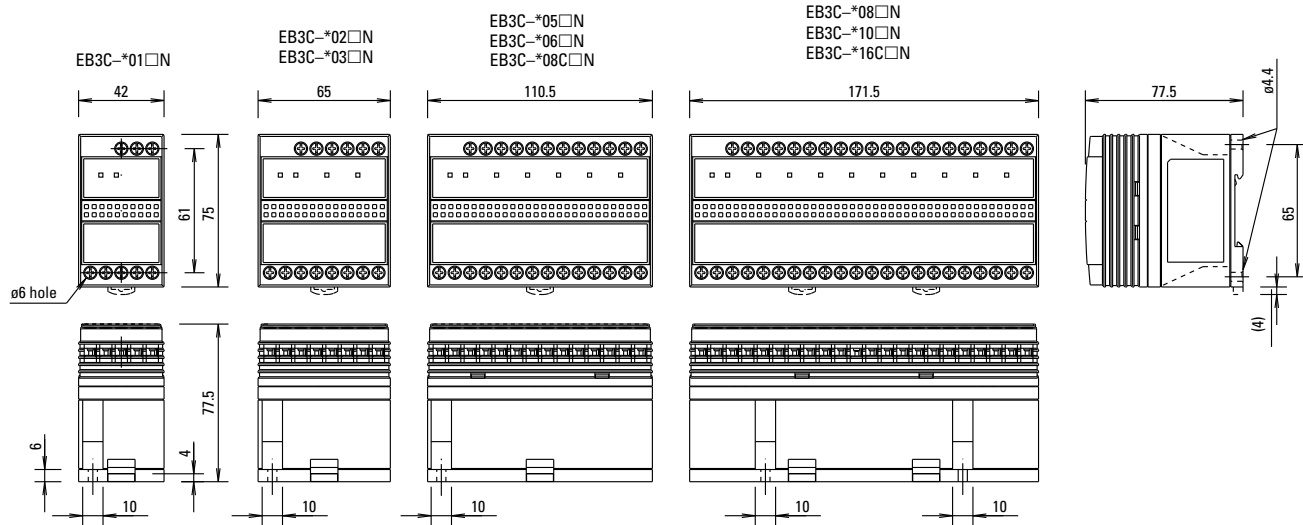


## Mounting Hole Layout (Screw Mounting)

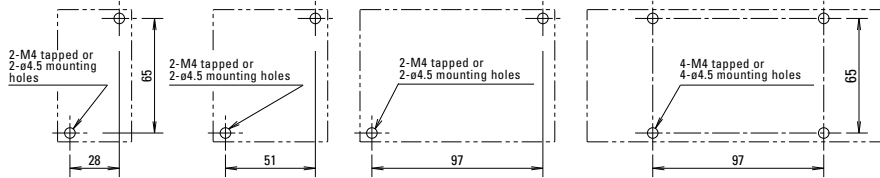


## Connector Type

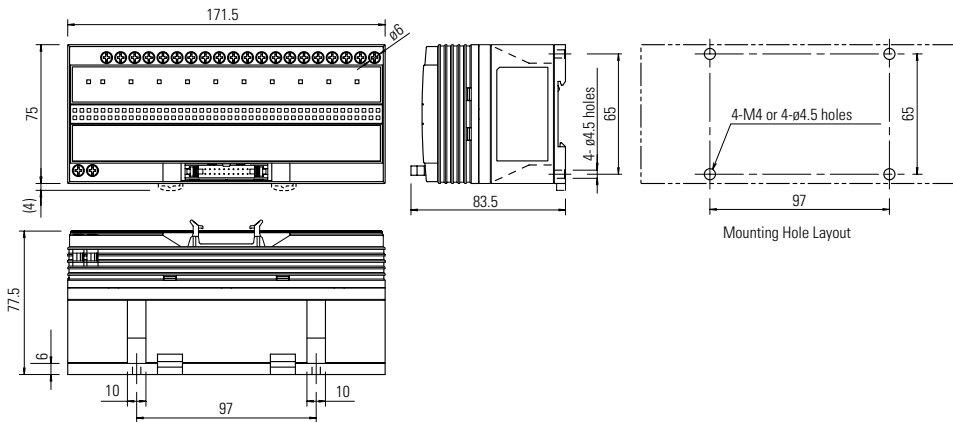

## Applicable Crimping Terminal



## Solid Wire - Strip wire end





## Stranded Wire - use a ferrule







## Connector Wiring Terminal Arrangement

## EB3C-T16CKD-CN (Sink)

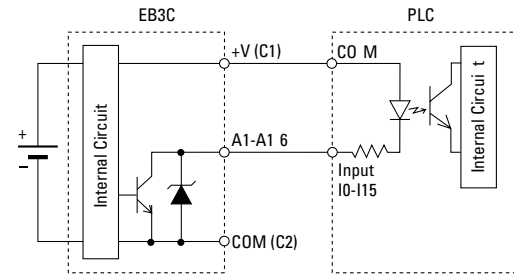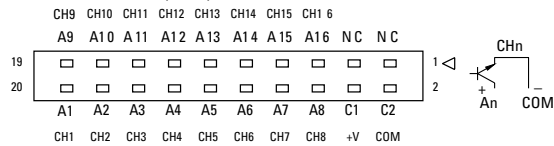

## EB3C-T16CSD-CN (Source)

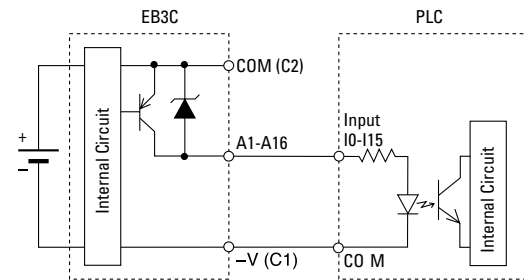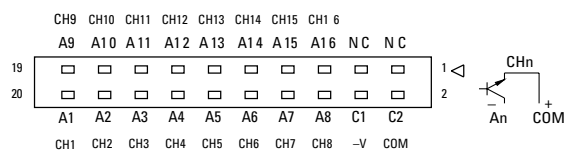

## EB3C-T16CKD-CN

## FC4A-N16B3

## EB3C-T16CSD-CN

## FC4A-N16B3

Terminal	Output	Input	Terminal	Terminal	Output	Input	Terminal
20	A1	I0	20			I0	20
19	A9	I10	19			I10	19
18	A2	I1	18			I1	18
17	A10	I11	17			I11	17
16	A3	I2	16			I2	16
15	A11	I12	15			I12	15
14	A4	I3	14			I3	14
13	A12	I13	13			I13	13
12	A5	I4	12			I4	12
11	A13	I14	11			I14	11
10	A6	I5	10			I5	10
9	A14	I15	9			I15	9
8	A7	I6	8			I6	8
7	A15	I16	7			I16	7
6	A8	I7	6			I7	6
5	A16	I17	5			I17	5
4	+V	COM	4			COM	4
3	NC	COM	3			COM	3
2	COM	NC	2			NC	2
1	NC	NC	1			NC	1



Note: The wiring in dashed line does not affect the operation of the EB3C.


Applicable connector is IDEC JE1S-201.

Output power for PLC outputs is supplied by the EB3C, therefore the PLC output does not need an external power supply.

## Wiring Example of Intrinsically Safe External Inputs



### 1. Common Wiring (Maximum 16 circuits)

All input lines are wired to a common line inside the intrinsically safe switch (one common line per intrinsically safe circuit).

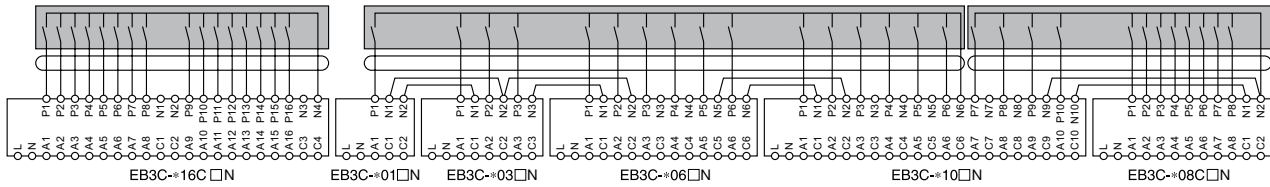


## Recommended Connector Cable for Connector Types

Description	No. of Poles	Length (m)	Part Number	Shape	Applicable Type
I/O Terminal Cable	With Shield	0.5	FC9Z-H050A20		IDEC MicroSmart I/O Module
		1	FC9Z-H100A20		
		2	FC9Z-H200A20		
	Without Shield	0.5	FC9Z-H050B20		IDEC MicroSmart I/O Module
		1	FC9Z-H100B20		
		2	FC9Z-H200B20		
Cable with Crimping Terminal	20	3	FC9Z-H300A20		Screw Terminal
		0.5	FC9Z-H050B20		
		1	FC9Z-H100B20		
40-pin Cable for PLC	Without Shield	2	FC9Z-H200B20		IDEC MicroSmart I/O Module
		3	FC9Z-H300B20		
		1	BX9Z-H100E4		Screw Terminal
	With Shield	2	BX9Z-H200E4		
		3	BX9Z-H300E4		
	Without Shield	1	BX9Z-H100B		Mitsubishi A Series Input Module (positive common) ↓ EB3C-T16CKD-CN
		2	BX9Z-H200B		
		3	BX9Z-H300B		

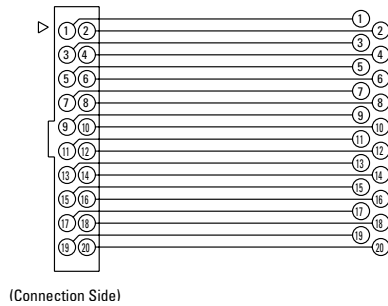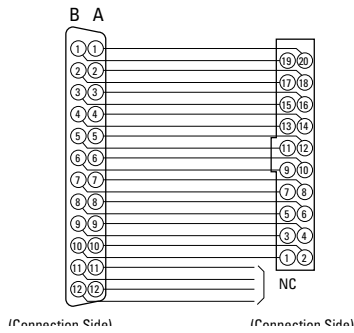FC9Z-H□□□A, FC9Z-H□□□B  
Internal ConnectionFujitsu Connector  
FCN-367J024-AU/FIDEC Connector  
JE1S-201IDEC Connector  
JE1S-201Y-shaped Compression  
Terminal  
(Marking Tube No.)

## BX9Z-H□□□B Internal Connection

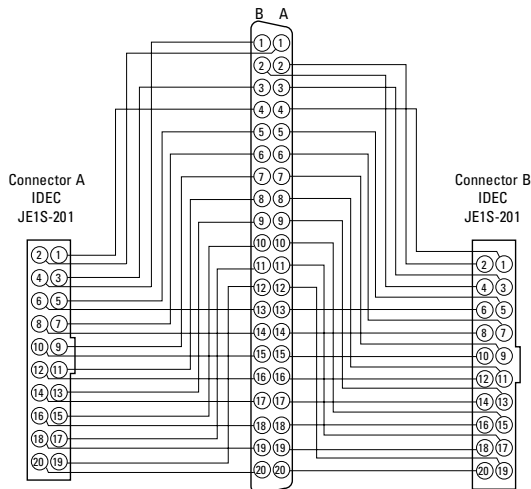Fujitsu Connector  
FCN-367J040-AU/F


## Installing the EB3C Intrinsically Safe Barriers

1. The EB3C can be installed in any direction.
2. Install the EB3C intrinsically safe barrier in a safe area (non-hazardous area) in accordance with intrinsic safety ratings and parameters. To avoid mechanical shocks, install the EB3C in an enclosure which suppresses shocks.
3. When installing or wiring the EB3C, prevent electromagnetic and electrostatic inductions in the intrinsically safe circuit. Also prevent the intrinsically safe circuits from contacting with another intrinsically safe circuit and any other circuits.

Maintain at least 50mm clearance, or provide a metallic separating board between the intrinsically safe circuit and non-intrinsically safe circuit. When providing a metallic separating board, make sure that the board fits closely to the enclosure (top, bottom, and both sides). Allowable clearance between the enclosure and board is 1.5mm at the maximum.

The clearance of 50mm between the intrinsically safe circuit and non-intrinsically safe circuit may not be sufficient when a motor circuit or high-voltage circuit is installed nearby. In this case, provide a wider clearance between the circuits referring to 5 (3) "Minimum Parallel Distance between the Intrinsically Safe Circuit and Other Circuits."

4. In order to prevent contact between intrinsically safe circuits and non-intrinsically safe circuits, mount EB3C units with terminals arranged in the same direction.

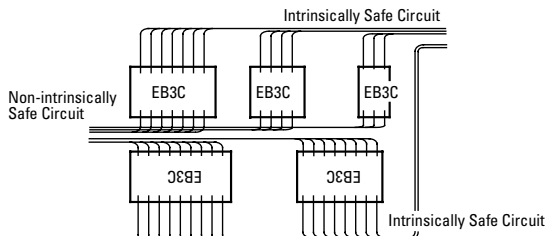

5. Maintain at least 6mm (or 3mm according to IEC60079-11: 1999) clearance between the terminal of an intrinsically safe circuit and the grounded metal part of a metal enclosure, and between the relay terminal block of an intrinsically safe circuit and the grounded metal part of a metal enclosure.
6. For installing the EB3C, mount on a 35mm-wide DIN rail or directly on a panel using screws. Make sure to install securely to withstand vibration. When mounting on a DIN rail, push in the clamp completely. Use the BNL6 end clips on both sides of the EB3C to prevent from moving sideways.
7. Excessive extraneous noise may cause malfunction and damage to the EB3C. When extraneous noise activates the voltage limiting circuit (thyristor), remove the noise source and restore the power.

### Terminal Wiring

1. Using a  $\phi 5.5\text{mm}$  or smaller screw driver, tighten the terminal screws (including unused terminal screws) to a torque of 0.6 to 1.0N·m (recommended value).
2. Make sure that IP20 is achieved when wiring. Use insulation tubes on bare crimping terminals.
3. To prevent disengaged wires from contacting with other intrinsically safe circuits, bind together the wires of one intrinsically safe circuit.
4. When the adjacent terminal is connected to another intrinsically safe circuit, provide an insulation distance of at least 6mm.

### Switches in the Hazardous Area

1. A switch contains the switch contact, enclosure, and internal wiring. A switch contact refers to an ordinary switching device which consists of contacts only, such as a pushbutton switch. See below.

## Applicable Switches

Control Switches	Push-pull Switches	Pushbutton, Foot, Trigger, Rocker, Grip
	Twisting Switches	Rotary, Selector, Cam, Drum, Thumb wheel
	Lever and Slide Switches	Toggle, Multidirectional, Wobble stick, Lever, Slide switch
Sensing Switches	Displacement Switches	Microswitch, Limit, Magnetic proximity, Door, Reed, Mercury
	Level Switches	Liquid level
	Others	Pressure, Temperature

**Note:** For installation in hazardous areas and connection to the EB3C, use switches which are certified, approved, or considered to be simple apparatus in relevant standards in each country.

2. When the switch has internal wiring or lead wire, make sure that the values of internal inductance (Li) and capacitance (Ci) are within the certified values.
3. Enclose the switch contact's bare, live part in an enclosure of IP20 or higher protection.
4. Depending on the explosion-protection specifications according to TIIS, the exposed area of the plastic switch operator is limited as follows:  
 Exia II CT6 (EB9Z-A): 20cm<sup>2</sup> maximum  
 Exia II BT6 (EB9Z-A1): 100cm<sup>2</sup> maximum
5. Attach the certification mark supplied with the EB3C on the EB9Z-A or EB9Z-A1 switch (for Japanese applications).
6. When the switch operator of the plastic enclosure has a wider exposed area than the following limits, attach a caution label.

- II C: 20 cm<sup>2</sup> maximum  
 II B: 100 cm<sup>2</sup> maximum


**Caution**  
 To prevent electrostatic charges, do not rub the switch surface during operation.  
 Use a soft cloth dipped with water for cleaning.

#### Caution Label Example

7. For the 1-circuit separate wiring, a resistor to prevent reed switch contact welding and an LED miniature pilot light can be connected in series with the contact. See below. Use the terminal screw of M3 or larger.

## Applicable Resistor Ratings

Resistance	100Ω maximum
Rated Wattage	0.5 to 3W
Type	Metal (oxide) film resistors



## IPL1 series LED miniature pilot lights Output Specifications

1. When wiring the output from the EB3C, connect the non-intrinsically safe circuit to terminals A and C. The EB3C output circuit is not equipped with short-circuit protection. If required, provide a protection in the external circuit.
2. Relay Output

Some types of loads generate reverse emf (such as solenoids) or cause a large inrush current (incandescent lamps), resulting in a shorter operation life of output relay contacts. The operation life of contacts can be extended by preventing the reverse emf using a diode, RC, or varistor, or by suppressing the inrush current using a resistor or RL.


Contacts are made of gold-clad silver. When using at a small current and a low voltage (reference value: 0.1mA, 0.1V), test the contact on the actual circuit in advance.

### 3. Transistor Output

When connecting a small load, the load may not turn off because of a leakage current, even though the transistor output is turned off. If this is the case, connect a resistor in parallel with the load to bypass the leakage current.

When an excessively high voltage (clamps at 33V, 1W) or a reverse voltage is applied to the output terminals, the clamping circuit or output transistor may be damaged.

When driving an inductive load, be sure to connect a diode across the load to absorb reverse emf.

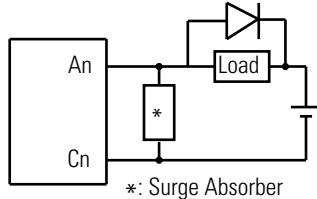

\*: Surge Absorber

#### Example of Overvoltage Absorption Circuit

4. In the common wiring only types, the output terminals are not isolated from each other.
5. When connecting the connector type EB3C's in parallel, use one power supply to power the EB3C's. Do not connect any wiring to the C1 and C2 terminals.

#### Wiring for Intrinsic Safety

1. The voltage applied on the general circuit connected to the non-intrinsically safe circuit terminals of the EB3C relay barrier must be 250V AC, 50/60Hz, or 250V DC at the maximum under any conditions, including the voltage of the input power and the internal circuit.
2. When wiring, take into consideration the prevention of electromagnetic and electrostatic charges on intrinsically safe circuits. Also, prevent intrinsically safe circuits from contacting with other circuits.
3. The intrinsically safe circuits must be separated from non-intrinsically safe circuits. Contain intrinsically safe circuits in a metallic tube or duct, or separate the intrinsically safe circuits referring to the table below.

Note: Cables with a magnetic shield, such as a metallic sheath, prevent electromagnetic induction and electrostatic induction, however, a non-magnetic shield prevents electrostatic induction only. For non-magnetic shields, take a preventive measure against electromagnetic induction.

Finely twisted pair cables prevent electromagnetic induction. Adding shields to the twisted pair cables provides protection against electrostatic induction.

#### Minimum Parallel Distance between the Intrinsically Safe Circuit and Other Circuits (mm)

Voltage and Current of Other Circuits	Over 100A	100A or less	50A or less	10A or less
Over 440V	2000	2000	2000	2000
440V or less	2000	600	600	600
220V or less	2000	600	600	500
110V or less	2000	600	500	300
60V or less	2000	500	300	150

4. When identifying intrinsically safe circuits by color, use light blue terminal blocks and cables.
5. When using two or more EB3C's to set up one intrinsically safe circuit in the common wiring configuration, interconnect two neutral terminals (N1 through N10) on each EB3C between adjacent EB3C's in parallel.
6. Make sure that the power of the EB3C and contact are turned off before starting inspection or replacement.
7. When wiring the intrinsically safe circuit, determine the distance to satisfy the wiring parameters shown below. Note that parameters are different

between separate wiring and common wiring.

- a. Wiring capacitance  $C_w \leq C_o - (C_i + N \times 2 \text{ nF})$   
 $C_o$ : Maximum external capacitance of the EB3C  
 $C_i$ : Internal capacitance of the switch  
 $N$ : The number of switches connected in series or parallel (the number is infinite)
- b. Wiring inductance  $L_w \leq L_o - (L_i + N \times 5 \text{ } \mu\text{H})$   
 $L_o$ : Maximum external inductance of the EB3C  
 $L_i$ : Internal inductance of the switch  
 $N$ : The number of switches connected in series or parallel (the number is infinite)
- c. Wiring resistance  $\leq R_w$   
 $R_w$ : Allowable wiring resistance
- d. Allowable wiring distance  $D$  (km) is the smallest value of those calculated from the capacitance, inductance, and resistance.
 

$D \leq C_w/C$   
 $D \leq L_w/L$   
 $D \leq R_w/2R$

$C$  (nF/km): Capacitance of cable per km  
 $L$  (mH/km): Inductance of cable per km  
 $R$  ( $\Omega$ /km): Resistance of cable per km

Note: For the details of wiring the intrinsically safe circuits, refer to a relevant test guideline for explosion-proof electric equipment in each country.

#### 8) Applicable Wire Size

0.5 to 2.0mm<sup>2</sup> (AWG20 to AWG14): two wires


However, one wire for 2.0 mm<sup>2</sup> (AWG14)

#### Mounting Bracket

The following mounting brackets can be used to install the EB3C relay barriers and EB3L lamp barriers on the mounting holes of IBRC contact signal transducer, IBPL pilot relay barrier, and IBZ buzzer.

No. of Channels	Part No.	Dimension (mm)		
		A	B	C
1	EB9Z-K01	28.0	44.0	61.0
2	EB9Z-K02	51.0	59.5	76.0
3	EB9Z-K03	51.0	75.0	91.5
5	EB9Z-K05	97.0	105.0	122.0
6	EB9Z-K06	97.0	120.0	137.0
10	EB9Z-K10	97.0	181.0	198.0

#### Dimensions

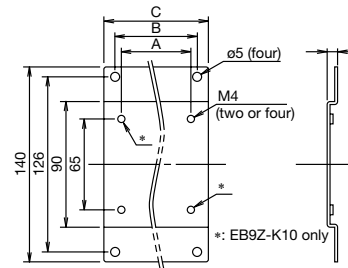


All dimensions in mm.

## EB3N Discrete Input Barrier with Redundant Output

**Build a safety system in an explosive atmosphere.**

### Key features:

- Safety Performance** Performance level e Category 4
- [Exia] II C
- Ensures safety and machine safety in an explosive atmosphere
- Machine safety system can be built in compliance with ISO13849-1 Category 4, Performance level e.
- Safety input devices applicable in any explosive gas and hazardous areas are available.
- Available with auxiliary inputs (5 points) used to monitor the operating status of safety input devices
- Global usage  
USA (UL),  
Global IEC-Ex,  
Europe (ATEX),  
Japan (TIS),  
China (CQST)  
Machine safety: TÜV Rheinland
- No grounding required

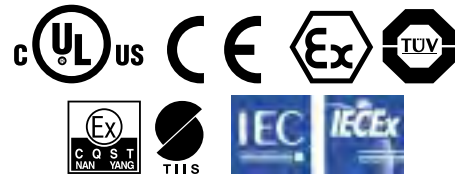

### Entity Barrier Parameters

Ta= 60°C, Um= 250V, (Um=125V UL only), Uo=13.2V, Io= 14.2mA, Po= 46.9mW at each channel  
Pn-Nn Io=227.2mA, Po= 750mW at max 16 channels Pn-Nn

Io(mA)	14.2	28.4	42.6	56.8	71.0	85.2	99.4	113.6	127.8	142.0	156.2	170.4	184.6	198.8	213.0	227.2	Combined
Po(mW)	46.9	93.8	140.6	187.5	234.3	281.2	328.1	375.9	421.8	468.7	515.5	562.4	609.2	656.1	702.9	750	Lo(mH)
Co(μF)	0.67	0.65	0.63	0.61	0.59	0.57	0.55	0.53	0.51	0.49	0.47	0.44	0.42	0.39	-	-	1.0
	0.79	0.77	0.76	0.75	0.73	0.72	0.70	0.69	0.67	0.66	0.64	0.62	0.61	0.59	0.57	0.55	0.5
	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.93	0.92	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.2
	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.1
Note 1 Added to above table, the next values combined Lo and Co are allowable;																	
Io(mA)	14.2				28.4				227.2								
Lo(mH)	175*	87.5	30.0	2.5	0.55	0.25	43.5*	21.5	20.0	3.5	0.43	0.25	0.68*	0.34	0.68	0.6	0.22 0.13
Co(μF)	0.90*	0.45	0.33	0.54	0.77	0.90	0.90*	0.45	0.30	0.48	0.80	0.90	0.90*	0.45	0.45	0.49	0.80 0.90

Note 2 The intrinsic safe apparatus and wirings shall be accordance to following formulas; for example:  $U_i \geq U_o$   $I_i \geq I_o$   $P_i \geq P_o$   $C_i + C_c \leq C_o$   $L_i + L_c \leq L_o$

\*: Therefore, the values are allowable only at  $L_i \leq 1\%L_o$  and  $C_i \leq 1\%C_o$  of the intrinsic safe apparatus. (In the case of 50% of  $C_o$  and  $L_o$  parameters are applicable, the maximum capacitance allowed shall not be more than  $C_o = 1 \mu F$  for IIB and  $C_o = 600 nF$  for IIC.)

TiISI only  
Ta=60°C, Um=250V

	1 ch Seperate	5 ch Common
Uo	13.2V	13.2V
Io	14.2mA	227.2mA
Po	46.9mW	750mW
Co	0.47μF	0.28μF
Lo	87.5mH	0.56mH

### Discrete Input Barrier with Redundant Output

2	2NO	Without	Without	Auto reset (Auto start)	EB3N-A2ND
				Manual reset (Manual start)	EB3N-M2ND
2	2NO	5 (1 common)	5NO (1 common)	Auto reset (Auto start)	EB3N-A2R5D
				Manual reset (Manual start)	EB3N-M2R5D

- A maximum of five monitor contacts from safety input devices can be connected to the auxiliary input terminals. In addition, non-safety input devices can also be connected to the auxiliary input terminals.
- On auto reset (auto start) models, when the safety condition is met (two safety inputs are both on), safety outputs are turned on automatically.  
Connect the reset (start) input terminals Y1 and Y2 together except for the following cases:  
When connecting a contactor or force guided relay to the safety output of the EB3N, connect the NC contacts of the contactor or force guided relay to the reset (start) input terminals Y1 and Y2 of the EB3N for use as a backcheck input signal.
- On manual reset (manual start) models, while the safety condition is met (two safety inputs are both on), safety outputs are turned on at the falling edge of the reset switch (start switch) signal (OFF → ON → OFF) (start off check).  
Manual reset (manual start) models have a monitoring function of reset switch contacts (detection of welded contacts). Use NO contacts of a momentary switch for the reset (start) input.  
When connecting a contactor or force guided relay to the safety output of the EB3N, connect the NC contacts of the contactor or force guided relay to the reset (start) input terminals Y1 and Y2 of the EB3N for use as a backcheck input signal.

## Selection Guide

### 1. Selecting the reset (start) function

**Auto reset (auto start):** Select this model when connecting safety control devices, such as safety relay modules or safety controllers, to the EB3N safety outputs to set up a safety system, using the reset (start) function of the safety control device.

Select this model when connecting contactors or force guided relays to the EB3N safety outputs to set up a safety system, and a risk assessment on the entire system has not found any safety problem in using auto reset (auto start).

**Manual reset (manual start):** Select this model when connecting contactors or force guided relays to the EB3N safety outputs to set up a safety system, and a risk assessment on the entire system has found that manual reset (manual start) is necessary.

### 2. Selecting the auxiliary outputs


**Without auxiliary outputs:** Select this model when the operating status of safety input devices are not monitored.

**With auxiliary outputs:** Select this model when the operating status of safety input devices are monitored or when non-safety input devices are also connected.

## Specifications

### EB3N General Specifications

Rated Power Voltage			24V DC
Power Voltage Range			20.4 to 26.4V DC
Operating Temperature			−20 to +60°C (no freezing) UL: −20 to +40°C (no freezing)
Operating Humidity			45 to 85% RH (no condensation)
Power Consumption	Without auxiliary output		5.5W maximum
	With auxiliary output		7.0W maximum
Safety Output	Contacts	13-14, 23-24	2NO
	Rated Load	Resistive	30V DC, 1A
		Inductive	DC-13, 24V, 1A
	Response (rated voltage)	Turn on	100 ms maximum
		Turn off	20 ms maximum
Auxiliary Output	Contacts	A* - C1	5NO/1 common
	Rated Load	Resistive	24V DC, 3A, common terminal 5A max.
	Response (rated voltage)	Turn on	15 ms maximum
		Turn off	10 ms maximum
Mounting			DIN rail or panel mounting

 \*: Channel Numbers: 1 to 5

### EB3N Safety Specifications

Category	4
Performance Level (PL)	e
Mean Time to Dangerous Failure (MTTFd)	100 years
Diagnostic Range	99% minimum



Calculation conditions for MTTFd

$t_{cycle}$ : Mean operation cycle = 1 hour

$h_{op}$ : Mean operation hours per day = 24 hours

$d_{op}$ : Mean operation days per year = 365 days




Note: When  $t_{cycle}$  is shorter than 1 hour, MTTFd will decrease

### EB3N Certifications

Certification Organization	Ratings	Certification Number
UL	Class I, Zone 0, [AExia] II C Class I, II, III, Div. 1, Groups A, B, C, D, E, F and G	E234997
PTB (IEC-Ex)	[Exia] II C, [Exia D]	IEC Ex PTB 10.0015
PTB (ATEX)	II (1) G [Exia] II C II (1) D [Exia D]	PTB 09 ATEX 2046
TIIS	Discrete Input Barriers with Redundant Output [Exia] II C Switch (EB9Z-A) Exia II CT6 Switch (EB9Z-A1) Exia II BT6	TC18753 TC15758 TC15961
CQST	[Exia] IIC	CNEx11.0038




Dimensions (mm)




Mounting Hole Layout

EB3N-A2ND  
EB3N-M2ND



EB3N-A2R5D  
EB3N-M2R5D



Terminal Functions


24V DC	Power
Y1-Y2	Reset input (Start input)
11-12	Safety input 1
21-22	Safety input 2
N1, N2	Signal ground
P*-N3	Auxiliary input
13-14	Safety output 1
23-24	Safety output 2
A*-C1	Auxiliary output



\*: 1 to 5


EB3N System Configuration Examples

1:1 connection with a safety input device, compliant with Category 4

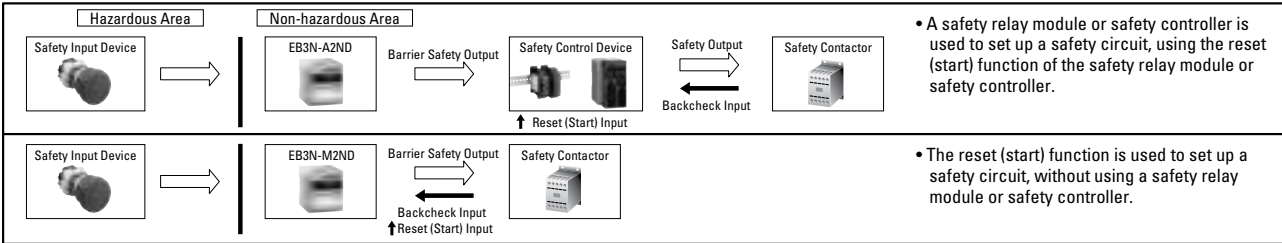


Connection with multiple safety input devices, capable of monitoring up to 5 contact operations, compliant with Category 3

For monitoring operating statuses of safety input devices located in a non-hazardous area

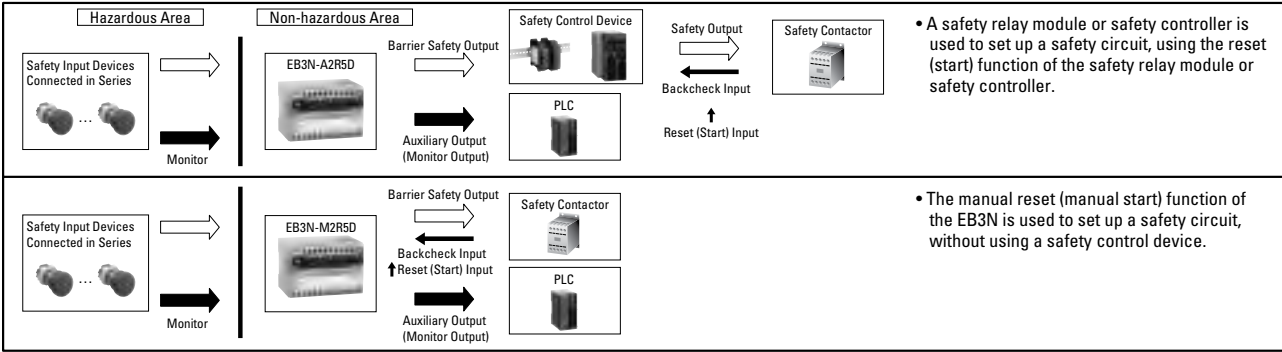



## Installing a reset switch in a hazardous area, using auxiliary input and output

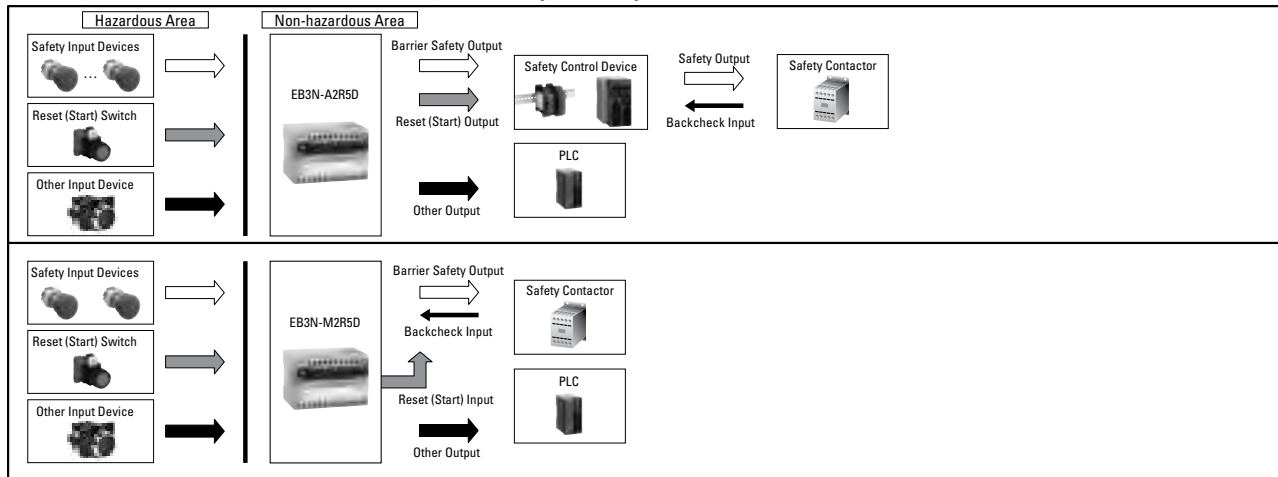

## Safety Input Devices Connectable to Safety Input Terminals (Examples)

Emergency stop switch: (Non-illuminated) XW1E-BV402M-R, XN4E-BL412MRH  
 Safety switch: HS6B-02B05, HS1B-02R

## Instructions

## Notes for Operation

1. Do not disassemble, repair, or modify the EB3N discrete input barrier with redundant output, otherwise the safety characteristics may be impaired.
2. Use the EB3N within its specification values.
3. The EB3N can be mounted in any direction.
4. Mount the EB3N on a 35-mm-wide DIN rail or directly on a panel surface using screws. When mounting on a DIN rail, push in the clamp and use end clips to secure the EB3N. When mounting on a panel surface, tighten the screws firmly.
5. Excessive noise may cause malfunction or damage to the EB3N. When the internal voltage limiting circuit (thyristor) has shut down the power due to noise, remove the cause of the noise before powering up again.
6. The internal power circuit contains an electronic fuse to suppress overcurrents. When the electronic fuse has tripped, shut down the power, remove the cause of the overcurrent before powering up again.
7. Use crimping terminals with insulation sheath for wiring. Tighten the terminal screws, including unused terminal screws, to a recommended tightening torque of 0.6 to N-m using a screwdriver of  $\phi 5.5$  mm in diameter.
8. Before inspecting or replacing the EB3N, turn off the power.

## Notes for Machine Safety

1. Operate the safety input device to check the EB3N functionality everyday.
2. For safety input devices, such as safety switches or emergency stop switches, connected to the EB3N, use safety standard-compliant devices with direct opening action and 2NC contacts.
3. Do not use the auxiliary input as a safety input.
4. For safety control devices connected with the EB3N, use machine safety standard-compliant devices with a disparity detection function.
5. Use safety inputs and safety outputs in a circuit configuration compliant with safety requirements.
6. To calculate the safety distance, take into consideration the response time of all devices comprising the system, such as the EB3N and safety devices connected to the EB3N.
7. Separate the input and output wiring from power lines and motor lines.
8. When using multiple EB3N discrete input barriers with redundant output, do not connect one switch to more than one EB3N. Use separate switches for each EB3N.
9. To ensure EMC, use shielded cables for safety inputs and auxiliary inputs. Connect the shield to the FG of the control panel on which the EB3N is mounted.
10. For protection against overcurrents, connect an IEC60127-2-compliant 2A fast-blow fuse ( $5 \times 20$  mm).
11. Evaluate the ISO 13849-1 category and performance level in consideration of the entire system.

## Safety Notes

1. Install the EB3N in an enclosure capable of protecting against mechanical shocks at a hazardous location in accordance with intrinsic safety ratings and parameters.
2. Install and wire the EB3N so that the EB3N is not subject to electromagnetic and electrostatic induction and does not contact with other circuits. For example, keep a minimum spacing of 50 mm between intrinsically safe and non-intrinsically safe circuits, or provide a metallic separating board between the intrinsically safe circuit and non-intrinsically safe circuit. When providing a metallic separating board, make sure that the board fits closely to the enclosure (top, bottom, and both sides). Allowable clearance between the board and the enclosure is 1.5 mm at the maximum. When a motor circuit or high-voltage circuit is installed nearby, keep a wider spacing than 50 mm between intrinsically safe and non-intrinsically safe circuits.
3. Keep a minimum spacing of 3 mm between the terminal or relay terminal block of the intrinsically safe circuit and the grounded metal parts of the metal enclosure.
4. Connect the terminals so that IP20 is ensured.
5. To prevent disengaged wires from contacting with other intrinsically safe circuits, bind together the end of wires.
6. Make sure that the voltage of the power supply for the devices connected to the non-intrinsically safe circuit or the internal voltage of such devices does not exceed 250V AC/DC 50/60 Hz (UL rating: 125V AC 50/60 Hz) or 250V DC (UL rating: 200V DC) under any normal and abnormal conditions.
7. Make sure that the wiring of intrinsically safe circuits does not contact with other circuits or is not subject to electromagnetic and electrostatic inductions, otherwise protection from hazards is not ensured.
8. When identifying intrinsically safe circuits by color, use light blue terminal blocks and cables.
9. When wiring the intrinsically safe circuit, determine the distance to satisfy the wiring parameters shown below.
  - a) Wiring capacitance  $C_w \leq C_o - C_i$ 
    - $C_o$ : Intrinsically safe circuit allowable capacitance
    - $C_i$ : Internal capacitance of switches
  - b) Wiring inductance  $L_w \leq L_o - L_i$ 
    - $L_o$ : Intrinsically safe circuit allowable inductance
    - $L_i$ : Internal inductance of switches
  - c) Wiring resistance  $\leq R_w$ 
    - $R_w$ : Allowable wiring resistance

## Switches in the Hazardous Area

1. A switch contains the switch contact, enclosure, and internal wiring. A switch contact refers to an ordinary switching device which consists of contacts only.
2. When the switch has internal wiring or lead wire, make sure that the values of internal capacitance ( $C_i$ ) and inductance ( $L_i$ ) are within the certified values.
3. Enclose the bare live part of the switch contact in an enclosure of IP20 or higher protection.

OI Touchscreens

PLCs

Automation Software

Power Supplies

Sensors

Communication

Barriers

## EB3L Discrete Output Barriers

126 types of pilot lights and buzzers can be connected. Illuminated pushbuttons and illuminated selector switches can be connected by combining with the EB3C discrete input barrier. No grounding required.

### Key features:

Ratings	
Discrete Output Barrier	[Exia] II C
Pilot Light (separate wiring)	Exia II CT6
Pilot Light (common wiring)	Exia II CT4
Illuminated Pushbutton	Exia II CT4
Illuminated Selector Switch	Exia II CT4
Buzzer (separate wiring)	Exiab II CT6

- IEC60079 compliant
- Compact and lightweight
- 8- and 16-channel types are available in common wiring types, ideal for connection to PLCs. 16-circuit types are also available with a connector.
- Universal AC power voltage (100 to 240V AC or 24V DC power [UL rating: 100 ~ 120V AC])
- No grounding required
- IDEC's original spring-up terminal minimizes wiring time.
- Installation, 35-mm-wide DIN rail mounting or direct screw mounting
- $\phi 6$ ,  $\phi 8$ ,  $\phi 10$ ,  $\phi 22$  and  $\phi 30$  pilot lights available
- Illuminated pushbuttons and illuminated selector switches can be connected by combining with the EB3C discrete input barrier. Illumination colors: Amber, blue, green, red, white, and yellow (pushlock turn reset type: red only)
- Continuous and intermittent sound types are available for buzzers ( $\phi 30$ ).
- Global usage
  - USA: UL/FM
  - Europe: CE marking
  - Global: IECEx, ATEX
  - Japan: TIIS
  - China: CQST
  - Korea: KCs
- Ship class: NK (Japan), KR (Korea)

### Entity Barrier Parameters

Ta= 60°C, Um= 250V, (Um=125V UL only), Uo=13.2V, Io= 14.2mA, Po= 46.9mW at each channel  
Pn-Nn Io=227.2mA, Po= 750mW at max 16 channels Pn-Nn

Io(mA)	14.2	28.4	42.6	56.8	71.0	85.2	99.4	113.6	127.8	142.0	156.2	170.4	184.6	198.8	213.0	227.2	Combined
Po(mW)	46.9	93.8	140.6	187.5	234.3	281.2	328.1	375.9	421.8	468.7	515.5	562.4	609.2	656.1	702.9	750	Lo(mH)
Co( $\mu$ F)	0.67	0.65	0.63	0.61	0.59	0.57	0.55	0.53	0.51	0.49	0.47	0.44	0.42	0.39	-	-	1.0
	0.79	0.77	0.76	0.75	0.73	0.72	0.70	0.69	0.67	0.66	0.64	0.62	0.61	0.59	0.57	0.55	0.5
	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.93	0.92	0.91	0.90	0.88	0.87	0.86	0.85	0.84	0.2
	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.94	0.1
Note 1 Added to above table, the next values combined Lo and Co are allowable;																	
Io(mA)	14.2				28.4				227.2								
Lo(mH)	175*	87.5	30.0	2.5	0.55	0.25	43.5*	21.5	20.0	3.5	0.43	0.25	0.68*	0.34	0.68	0.6	0.22
Co( $\mu$ F)	0.90*	0.45	0.33	0.54	0.77	0.90	0.90*	0.45	0.30	0.48	0.80	0.90	0.90*	0.45	0.45	0.49	0.80

Note 2 The intrinsic safe apparatus and wirings shall be accordance to following formulas; for example:  $U_i \geq U_o$   $I_i \geq I_o$   $P_i \geq P_o$   $C_i + C_c \leq C_o$   $L_i + L_c \leq L_o$

\*: Therefore, the values are allowable only at  $L_i \leq 1\%L_o$  and  $C_i \leq 1\%C_o$  of the intrinsic safe apparatus. (In the case of 50% of  $C_o$  and  $L_o$  parameters are applicable, the maximum capacitance allowed shall not be more than  $C_o = 1 \mu F$  for IIB and  $C_o = 600 nF$  for IIC.)

### Common Wiring for PLC Inputs

8- and 16-circuit types are available in common wiring types, ideal for connection to PLCs (DC voltage only).

### Connector Type

MIL connector on the non-hazardous side

- Easy connection to PLCs
- Wiring is reduced by 90%
- Various 20-pin MIL connectors can be connected.




### Illuminated Pushbutton/Selector Switches

Illuminated pushbutton/selector switches can be used with the combination of EB3C and EB3L.



### Spring-up Fingersafe Terminals Reduce Wiring Time

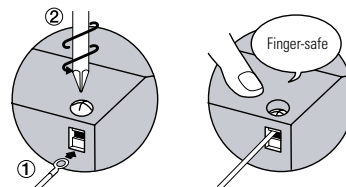

TIIS, NK only  
Ta=60°C, Um=250V

	1 ch Separate	16 ch Common 16
Uo	13.2V	13.2V
Io	14.2mA	227.2mA
Po	46.9mW	750mW
Co	0.47 $\mu$ F	0.365 $\mu$ F
Lo	87.5mH	0.425mH

## Specifications

## Electrical Specifications

Ratings		Intrinsic safety type (IEC compliant) [Exia] II C
Degree of Protection		IP20 (IEC60529)
Installation Location	Discrete Output Barrier	Safe indoor place (non-hazardous area)
	Pilot Light, Illuminated Switch,	For zone 0, 1, 2 hazardous areas
	Buzzer	For zone 1 and 2 hazardous areas
Non-intrinsically Safe Circuit Maximum Voltage (Um)		250V AC 50/60Hz, 250V DC UL value: 125V AC
Operation		Input ON, Output ON (1:1)

## Certifications

Certification Organization	Ratings	Certification No.
UL	Class I, II, III Div. 1 Group A, B, C, D, E, F, and G Class I, Zone 0 [AExia] II C	E234997
FM	Class I, II, III Div. 1 Group A, B, C, D, E, F, and G Class I, Zone 0 [AExia] II C	3047250
PTB (IEC-Ex)	[Exia] IIC: Gas vapor	IECEX PTB 10.0015
PTB (ATEX)	II(1)G [Exia] IIC: Gas vapor II(1)D [Exia] IIC: Dust	PTB09 ATEX2046
TIIS	Discrete output barrier: [Exia] II C	TC20541
	Pilot light/miniature pilot light: (separate wiring): Exia II CT6	TC16361
	Pilot light/miniature pilot light: (common wiring): Exia II CT4	TC16360
	Illuminated switch: Exia II CT4	TC16362
	Buzzer: Exib II CT6	TC20797
NK	Discrete output barrier: [Exia] II C Buzzer: Exib II CT6	Type Test No. 13T606 pending
CQST	[Exia Ga] IIC	CNEx 14.0047
KCs	Discrete output barrier: [Exia] II C Buzzer: Exib II CT6	KCS14-AV4B0-0375 pending
KR	[Exia] IIC	pending



Note: Illuminated switches, pilot lights, and miniature pilot lights are certified by TIIS and NK only. Other certification organizations, such as UL, regard these units as simple apparatus, and require no certification.

## General Specifications

Power Voltage Type	AC Power	DC Power
Rated Power Voltage	100 to 240V AC (UL rating: 100 ~ 120V AC)	24V DC
Allowable Voltage Range	85 to 264V AC (UL rating: 85 ~ 125V AC)	21.6 to 26.4V DC
Rated Frequency	50/60 Hz (allowable range: 47 to 63 Hz)	—
Inrush Current	10A (100V AC) 20A (200V AC)	10A
Dielectric Strength (1 minute, 1 mA)	Between intrinsically safe circuit and non-intrinsically safe circuit: 1526.4V AC Between AC power and signal input: 1500V AC	
Operating Temperature	-20 to +60°C (no freezing)	
Storage Temperature	-20 to +60°C (no freezing)	
Operating Humidity	45 to 85% RH (no condensation)	
Atmosphere	800 to 1100 hPa	
Pollution Degree	2 (IEC60664)	
Insulation Resistance	10 MΩ minimum (500V DC megger, between the same poles as the dielectric strength)	
Vibration Resistance (damage limits)	Panel mounting: 10 to 55 Hz, amplitude 0.75 mm (2 hours each on X, Y, Z)	
	DIN rail mounting: 10 to 55 Hz, amplitude 0.35 mm (2 hours each on X, Y, Z)	
Shock Resistance (damage limits)	Panel mounting: 500 m/s <sup>2</sup> (3 times each on X, Y, Z)	
	DIN rail mounting: 300 m/s <sup>2</sup> (3 times each on X, Y, Z)	
Terminal Style	M3 screw terminal	
Mounting	35-mm-wide DIN rail or panel mounting (M4 screw)	
Power Consumption (approx.)	8.8 VA (EB3L-S10SAN at 200V AC) 5.2 W (EB3L-S16CSDN at 24V DC)	

## Part Numbers




## Discrete Output Barriers

Power Voltage	Connection to Non-intrinsically Safe Circuit	Input	Input Wiring Method	Number of Channels	Part Number	Weight (g)
100 to 240V AC (UL rating: 100 ~ 120V AC)	Screw Terminal	Source	Separate/Common Wiring Compatible	1	EB3L-S01SAN	150
				2	EB3L-S02SAN	180
				3	EB3L-S03SAN	190
				5	EB3L-S05SAN	250
				6	EB3L-S06SAN	260
				8	EB3L-S08SAN	330
				10	EB3L-S10SAN	360
			Common Wiring Only	8	EB3L-S08CSAN	260
		Sink	Separate/Common Wiring Compatible	1	EB3L-S01KAN	150
				2	EB3L-S02KAN	180
				3	EB3L-S03KAN	190
				5	EB3L-S05KAN	250
				6	EB3L-S06KAN	260
				8	EB3L-S08KAN	330
				10	EB3L-S10KAN	360
			Common Wiring Only	8	EB3L-S08CKAN	260
24V DC	Screw Terminal	Source	Separate/Common Wiring Compatible	1	EB3L-S01SDN	130
				2	EB3L-S02SDN	160
				3	EB3L-S03SDN	170
				5	EB3L-S05SDN	240
				6	EB3L-S06SDN	250
				8	EB3L-S08SDN	310
				10	EB3L-S10SDN	250
			Common Wiring Only	8	EB3L-S08CSDN	340
				16	EB3L-S16CSDN	350
		Sink	Separate/Common Wiring Compatible	1	EB3L-S01KDN	130
				2	EB3L-S02KDN	160
				3	EB3L-S03KDN	170
				5	EB3L-S05KDN	240
				6	EB3L-S06KDN	250
				8	EB3L-S08KDN	310
				10	EB3L-S10KDN	340
			Common Wiring Only	8	EB3L-S08CKDN	250
				16	EB3L-S16CKDN	350
	Connector	Source	Common Wiring Only	16	EB3L-S16CSD-CN	350
		Sink		16	EB3L-S16CKD-CN	350

## Accessories

Name	Part Number	Description
DIN Rail	BAA1000	Aluminum (1m long, 10.5mm high)
	BAP1000	Steel (1m long, 7.5mm high)
End Clip	BNL6	Medium DIN rail end clip


## Internal Circuit Block Diagram

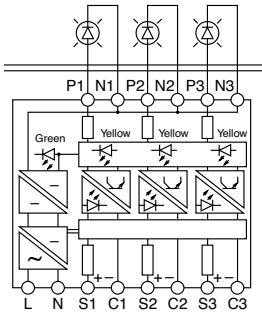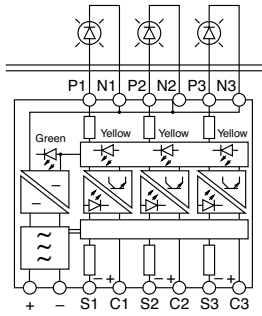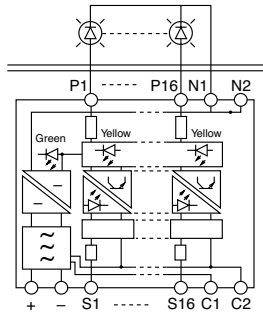AC Power  
Source InputDC Power  
Sink InputConnector Wiring  
Source Input


Hazardous Area  
Non-hazardous Area

## Dimensions (mm)


## Terminal

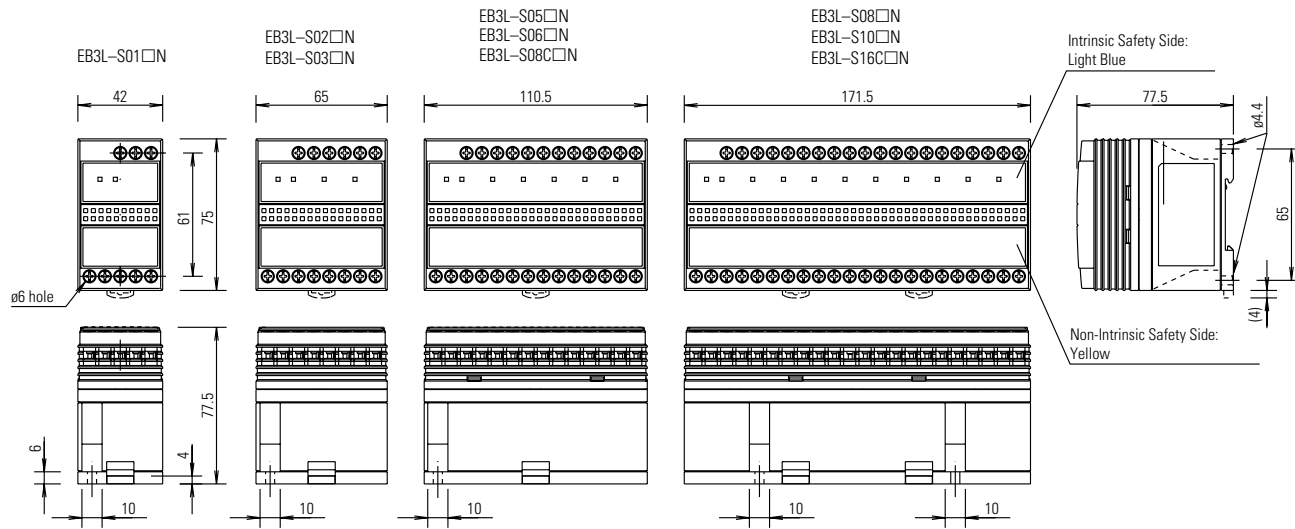


## Mounting Hole Layout (Screw Mounting)

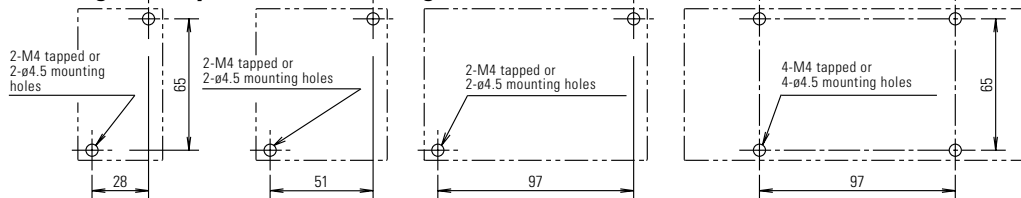


## Connector

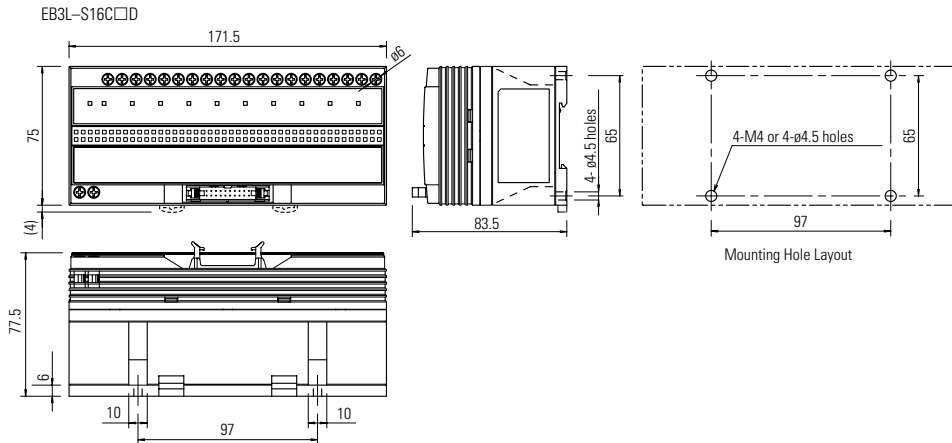


## Applicable Crimping Terminal



## Solid Wire - Strip wire end




## Stranded Wire - use a ferrule




## Non-intrinsically Safe External Input Wiring Examples


6-channel Source  
(Ex.: EB3L-S06SAN)

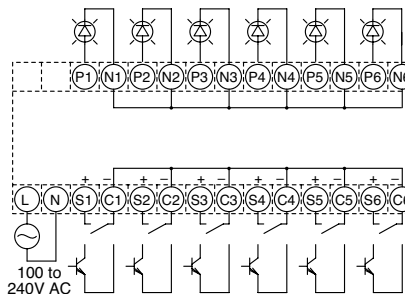


8-channel Common Wiring, Source  
(Ex.: EB3L-S08CSDN)

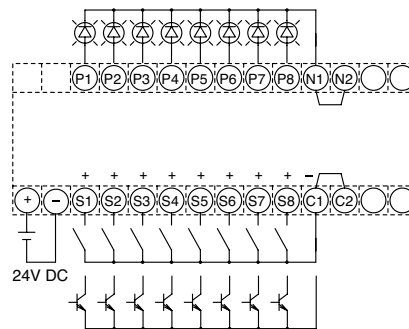

6-channel Sink  
(Ex. EB3L-S06KAN)

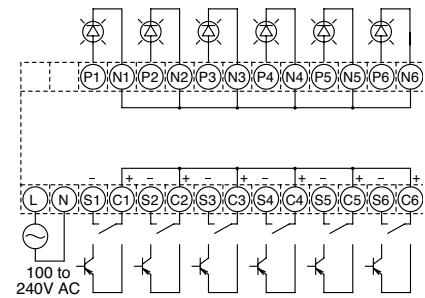


16-channel Common Wiring, Source  
(Ex.: EB3L-S16CSDN)

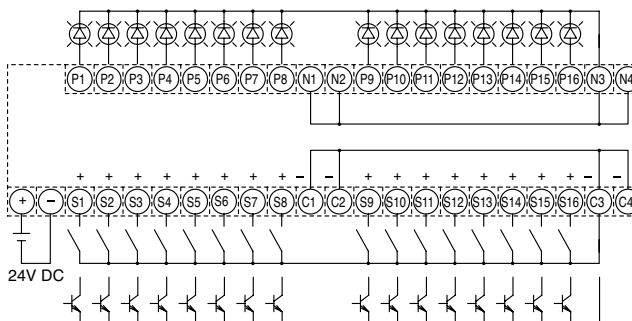

Note: Source input type can be connected to PLC sink output type C terminal is the negative common line.

16-channel Common Wiring, Sink  
(Ex.: EB3L-S16CKDN)

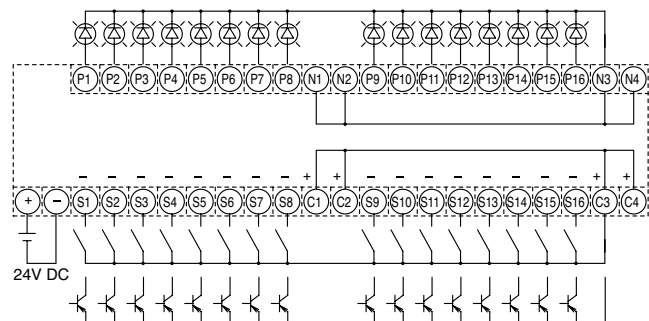

Note: Sink input type can be connected to PLC source output type C terminal is the positive common line.

All dimensions are in mm

OI Touchscreens

PLCs

Automation Software

Power Supplies



Sensors

Communication



Barriers

Connector Wiring Terminal Arrangement

EB3L-S16CSD-CN

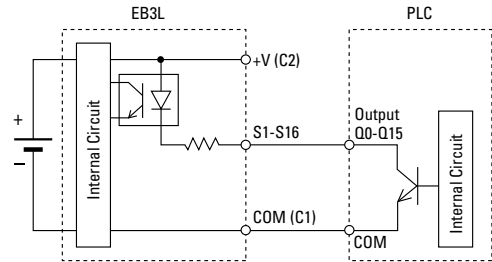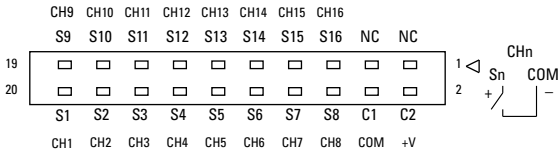

EB3L-S16CKD-CN

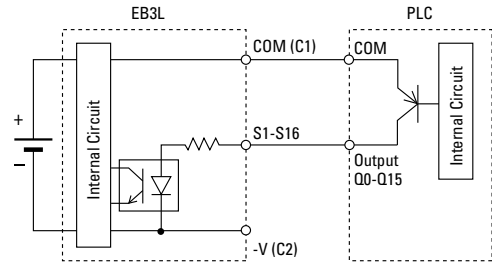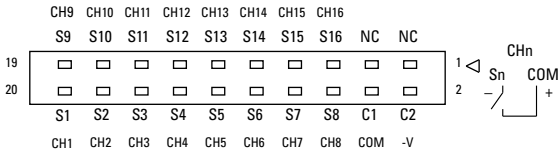

Wiring Example with IDEC's MicroSmart PLC Output Modules

FC4A-T16K3		EB3L-S16CSD-CN		FC4A-T16S3		EB3L-S16CKD-CN	
Terminal	Output	Input	Terminal	Terminal	Output	Input	Terminal
20	Q0	S1	20	20	Q0	S1	20
19	Q10	S9	19	19	Q10	S9	19
18	Q1	S2	18	18	Q1	S2	18
17	Q11	S10	17	17	Q11	S10	17
16	Q2	S3	16	16	Q2	S3	16
15	Q12	S11	15	15	Q12	S11	15
14	Q3	S4	14	14	Q3	S4	14
13	Q13	S12	13	13	Q13	S12	13
12	Q4	S5	12	12	Q4	S5	12
11	Q14	S13	11	11	Q14	S13	11
10	Q5	S6	10	10	Q5	S6	10
9	Q15	S14	9	9	Q15	S14	9
8	Q6	S7	8	8	Q6	S7	8
7	Q16	S15	7	7	Q16	S15	7
6	Q7	S8	6	6	Q7	S8	6
5	Q17	S16	5	5	Q17	S16	5
4	COM	COM	4	4	COM	COM	4
3	COM	NC	3	3	COM	NC	3
2	+V	+V	2	2	-V	-V	2
1	+V	NC	1	1	-V	NC	1


Note: The wiring in dashed line does not affect the operation of the EB3L.  
Applicable connector is IDEC's JE1S-201.  
Output power for PLC outputs is supplied by the EB3L, therefore the PLC output does not need an external power supply.




## Wiring Example of Intrinsically Safe External Outputs

### 1. Common Wiring (Maximum 16 circuits) (Buzzers cannot be wired in a common line.)\*

All output lines are wired to a common line inside the intrinsically safe equipment (one common line per intrinsically safe circuit) - DC input models only.

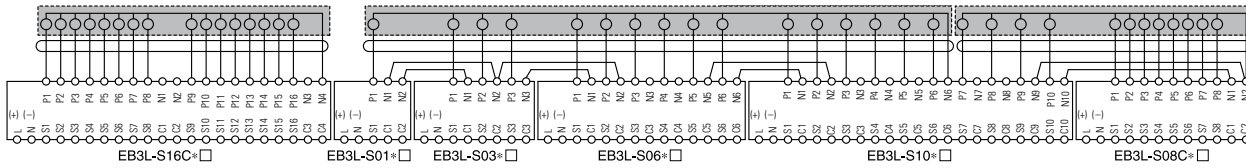


All input lines are wired to a common line outside the intrinsically safe equipment (one common line per intrinsically safe circuit).

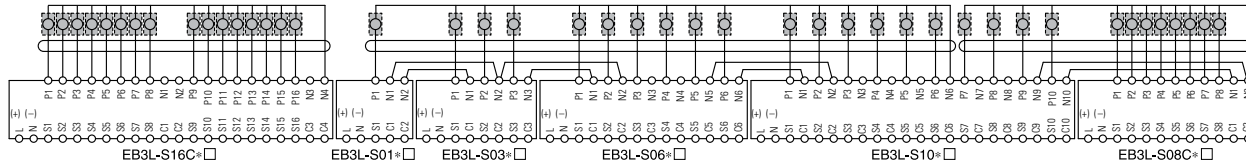

### 2. Separate Wiring

Each output line of the EB3L makes up one independent intrinsically safe circuit of a pilot light or buzzer.

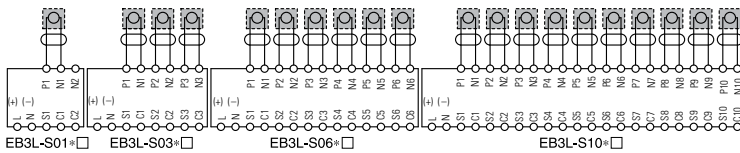

When using two or more EB3L's to set up one intrinsically safe circuit in the common wiring configuration, interconnect two neutral terminals (N1 through N10) on each EB3L between adjacent EB3L's in a parallel.

### 3. Wiring Illuminated Pushbuttons and Illuminated Selector Switches

(A maximum of 16 channels of EB3L and EB3C can be wired to a common line.)

The following example illustrates the wiring for a total of 10 contacts used by three illuminated pushbuttons (LB1 to LB3) and three illuminated selector switches (LS1 to LS3).


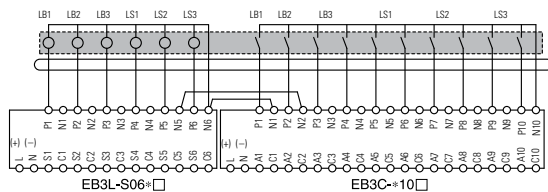


Diagram Symbols




\*This is permitted under TIS approvals


Recommended Connector Cable for Connector Types

Description		No. of Poles	Length (m)	Part Number	Shape	Applicable Type
I/O Terminal Cable	With Shield	20	0.5	FC9Z-H050A20		IDEC MicroSmart I/O Module
			1	FC9Z-H100A20		
			2	FC9Z-H200A20		
			3	FC9Z-H300A20		
	Without Shield		0.5	FC9Z-H050B20		IDEC MicroSmart I/O Module
			1	FC9Z-H100B20		
			2	FC9Z-H200B20		
			3	FC9Z-H300B20		
Cable with Crimping Terminal			1	BX9Z-H100E4		Screw Terminal
			2	BX9Z-H200E4		
			3	BX9Z-H300E4		
40-pin Cable for PLC			1	BX9Z-H100B		Mitsubishi A Series Output Module (sink) ↓ EB3L-S16CSD-CN
			2	BX9Z-H200B		
			3	BX9Z-H300B		


FC9Z-H□□□A, FC9Z-H□□□B Internal Connection

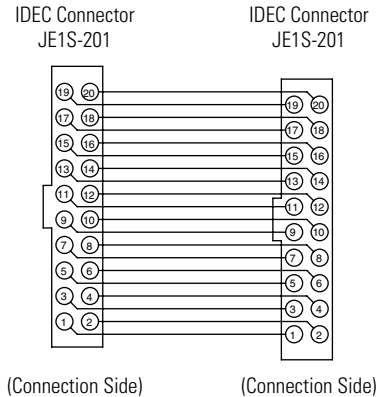

BX9Z-H□□□B Internal Connection

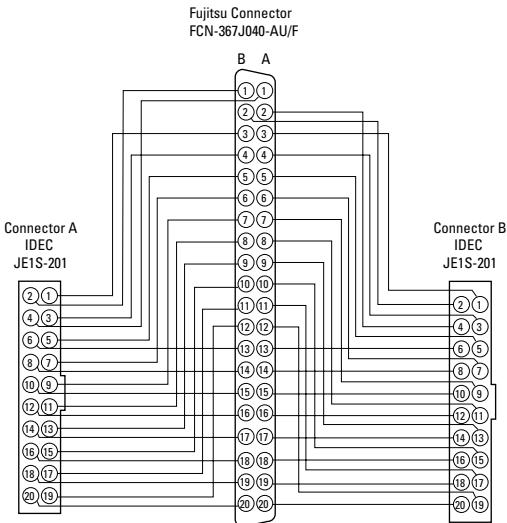

FC9Z-H□□□E4 Internal Connection

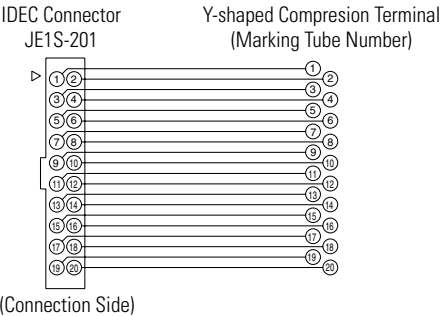

## Switches and Pilot Devices

## General Specifications for Pilot Light, Illuminated Pushbutton, Illuminated Selector Switch, and Buzzer

Operating Temperature	-20 to +60°C (no freezing)		
Operating Humidity	45 to 85% RH (no condensation)		
Dielectric Strength (1 mA, 1 minute)	EB3P: 1000V AC IPL1: 500V AC (between intrinsically safe circuit and dead parts)		
Insulation Resistance	10 MΩ minimum (500V DC megger, between the same poles as the dielectric strength)		
Pilot Light and Miniature Pilot Light	Degree of Protection	IP65 (IEC60529) (except for terminals) EB3P-LU/IPL1: IP40	
	Lens/Illumination Color	Pilot light: Amber, blue, green, red, white, yellow Miniature pilot light: Amber, green, red, white, yellow	
	Intrinsic Safety Ratings and Parameters	1-channel Separate Wiring	
		Maximum input voltage (Ui):	13.2V
Pilot Light and Miniature Pilot Light	Intrinsic Safety Ratings and Parameters	Maximum input current (Ii):	14.2 mA
		Maximum input power (Pi):	46.9 mW
		Internal capacitance (Ci):	≤ 2 nF
		Internal inductance (Li):	≤ 5 μH
		16-channel Common Wiring	
		Maximum input voltage (Ui):	13.2V
		Maximum input current (Ii):	227.2 mA
		Maximum input power (Pi):	750 mW
		Internal capacitance (Ci):	≤ 32 nF
		Internal inductance (Li):	≤ 80 μH

Illuminated Switch	Degree of Protection	IP65 (IEC60529) (except for terminals) EB3P-LSAW**: IP54	
	Illumination Color	Amber, blue, green, red, white, yellow	
	Contact Voltage/Current	12V DC ±10%, 10 mA ±20% (when connecting to the EB3C)	
	Intrinsic Safety Ratings and Parameters	16-channel Common Wiring	
Buzzer	Intrinsic Safety Ratings and Parameters	Maximum input voltage (Ui):	13.2V
		Maximum input current (Ii):	227.2 mA
		Maximum input power (Pi):	750 mW
		Internal capacitance (Ci):	≤ 32 nF
		Internal inductance (Li):	≤ 80 μH
		Degree of Protection	IP20 (IEC60529) (except for terminals)
		Sound Volume	75 dB minimum (at 1 m)
		Sound Source	Piezoelectric oscillator (continuous or intermittent)
		1-channel Separate Wiring	
		Maximum input voltage (Ui):	13.2V
Buzzer	Intrinsic Safety Ratings and Parameters	Maximum input current (Ii):	14.2 mA
		Maximum input power (Pi):	46.9 mW
		Internal capacitance (Ci):	≤ 260 nF
		Internal inductance (Li):	≤ 80 mH
Buzzer	Weight	100g	



Note: Connect buzzers in separate wiring. Buzzers cannot be used in common wiring.

## Part Numbers for Pilot Lights, Illuminated Pushbuttons, Illuminated Selector Switches, and Buzzers

Unit	Size	Series <sup>1</sup>	Shape	Operation Mode	Contact	Ordering Number	Lens Color/ Illumination Color Code*	Operation
Pilot Light	ø30	N	Dome	—	—	EB3P-LAN1-*	A: Amber G: Green R: Red S: Blue W: White ⁱY: Yellow	—
			Square	—	—	EB3P-LUN3B-*		
			Rectangular w/Metal Bezel	—	—	EB3P-LUN4-*		
			Dome w/Diecast Sleeve	—	—	EB3P-LAD1-*		
	ø22	TW	Flush	—	—	EB3P-LAW1-*		
			Flush(Marking Type)	—	—	EB3P-LAW1B-*		
			Dome	—	—	EB3P-LAW2-*		
			Square Flush (Marking Type)	—	—	EB3P-LUW1B-*		
		HW	Round Flush	—	—	EB3P-LHW1-*		
			Dome	—	—	EB3P-LHW2-*		
			Square Flush	—	—	EB3P-LHW4-*		
		LW	Round	—	—	EB3P-LLW1-*		
			Square	—	—	EB3P-LLW2-*		
			Round w/ Square Bezel	—	—	EB3P-LLW3-*		
Miniature Pilot Light	ø10	UP	Extended	—	—	IPL1-18-*	A: Amber G: Green R: Red W: White ⁱY: Yellow	—
			Dome	—	—	IPL1-19-*		
	ø8		Flush	—	—	IPL1-87-*		
			Extended	—	—	IPL1-88-*		
			Dome	—	—	IPL1-89-*		
	ø6		Flush	—	—	IPL1-67-*		
			Extended	—	—	IPL1-68-*		
			Dome	—	—	IPL1-69-*		

## Part Numbers for Pilot Lights, Illuminated Pushbuttons, Illuminated Selector Switches, and Buzzers, con't

Unit	Size	Series <sup>1</sup>	Shape	Operation Mode	Contact	Ordering Number <sup>2</sup>	Lens Color/ Illumination Color Code*	Operation			
Illuminated Pushbutton	ø30	N	Extended	Momentary	1NO-1NC	EB3P-LBAN211-*	A: Amber G: Green R: Red S: Blue W: White ⁵Y: Yellow	—			
				Maintained	1NO-1NC	EB3P-LBAON211-*					
			Mushroom	Pushlock Turn Reset	1NO-1NC	EB3P-LBAVN311-R			Red only		
	ø22	TW	Extended	Momentary	1NO-1NC	EB3P-LBAW211-*	A: Amber G: Green R: Red S: Blue W: White ⁵Y: Yellow				
				Maintained	1NO-1NC	EB3P-LBAOW211-*					
			Mushroom	Pushlock Turn Reset	1NO-1NC	EB3P-LBAVW411-R			Red only		
		HW	Round	Momentary	1NO	EB3P-LBH1W110-*					
				Maintained	1NO	EB3P-LBHA1W110-*					
		LW	Round	Momentary	DPDT	EB3P-LBL1W1C2-*					
				Maintained	DPDT	EB3P-LBLA1W1C2-*					
			Square	Momentary	DPDT	EB3P-LBL2W1C2-*					
				Maintained	DPDT	EB3P-LBLA2W1C2-*					
		Illuminated Selector Switch <sup>3</sup>	ø30	N	Round	2-position	1NO-1NC		EB3P-LSAN211-*	A: Amber G: Green R: Red S: Blue W: White ⁵Y: Yellow	Maintained
						3-position	2NO		EB3P-LSAN320-*		Maintained
ø22	TW		Round	2-position	1NO-1NC	EB3P-LSAW211-*	Maintained				
				2-position, return from right	1NO-1NC	EB3P-LSAW2111-*	Spring return from right				
				3-position	2NO	EB3P-LSAW320-*	Maintained				
				3-position, return from right	2NO	EB3P-LSAW3120-*	Spring return from right				
				3-position,return from left	2NO	EB3P-LSAW3220-*	Spring return from left				
				3-position,2-way return	2NO	EB3P-LSAW3320-*	2-way spring return				
				HW	Round	2-position	1NO-1NC	EB3P-LSHW211-*	Maintained		
	3-position		2NO			EB3P-LSHW320-*	Maintained				
	LW		Round		2-position	DPDT	EB3P-LSL1W2C2-*	Maintained			
			Round w/Square Bezel	3-position	DPDT	EB3P-LSL3W3C2-*	Maintained				
Buzzer	ø30		—	—	Continuous sound	—	EB3P-ZUN12CN	—	Approx. 3 Hz		
					Intermittent sound	—	EB3P-ZUN12FN	—			



1. Codes N, TW, HW, LW, and UP are the series names of IDEC's control units.
2. Specify a color code in place of \*.
3. Above parts are recommended for EB3L barriers. However, none of these parts are UL recognized.
4. Buzzers are not rated for Zone 0, but only Zones 1 and 2.
5. Use PW (pure white) LED for yellow lenses

## Accessory


Name	Ordering Number	Package Quantity	Remarks
LED Lamp	EB9Z-LDS1-*	1	Specify a color code in place of * in the ordering number. A: amber, G: green, R: red, S: blue, W: white, PW: pure white (for yellow use PW with yellow lens) Use PW (pure white) LED for yellow lenses
Static Electricity Caution Plate	EB9Z-N1PN10	10	Polyester 20(W) x 6(H) mm




Above part is recommended for EB3L barriers. However, this part is not UL recognized.

## Pilot Lights


## ø30 EB3P-LAN1

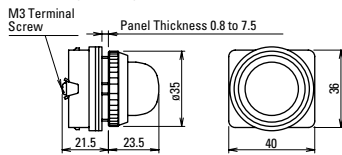Terminal Cover: APN-PVL  
(sold separately)


## ø30 EB3P-LUN4

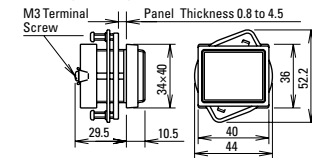Terminal Cover: APN-PVL  
(sold separately)


## ø30 EB3P-LAD

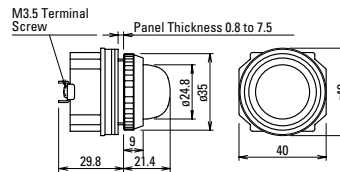Terminal Cover: APD-PVL  
(sold separately)


## ø30 EB3P-LUN3B

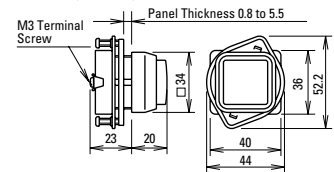Terminal Cover: APN-PVL  
(sold separately)


## ø22 EB3P-LAW1

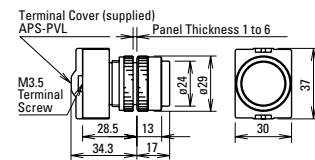


## ø22 EB3P-LAW1B

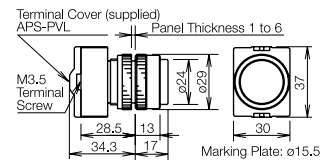

## ø22 EB3P-LAW2

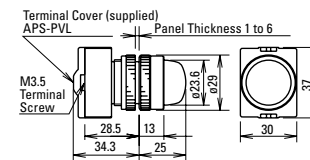


## ø22 EB3P-LUW1B

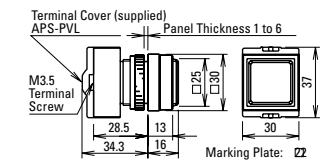


## ø22 EB3P-LHW1/EB3P-LHW2/EB3P-LHW4

Terminal cover attached.

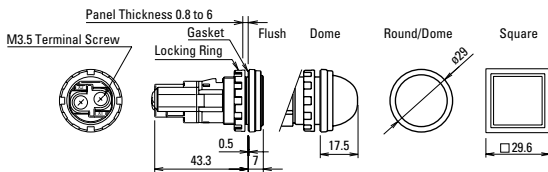


## ø22 EB3P-LLW1/EB3P-LLW2/EB3P-LLW3

Terminal cover attached.

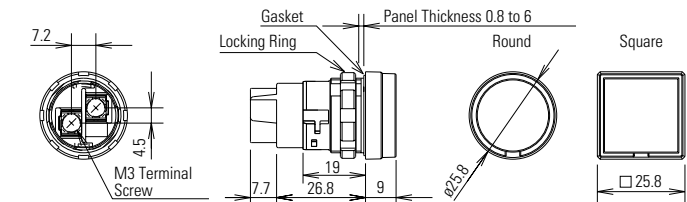


## Miniature Pilot Lights (Terminal cover not available)


## ø10 IPL1-18

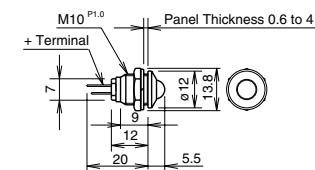


## ø10 IPL1-19

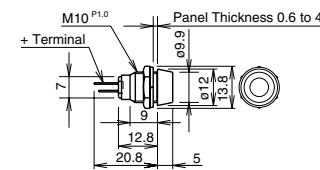


## ø8 IPL1-87

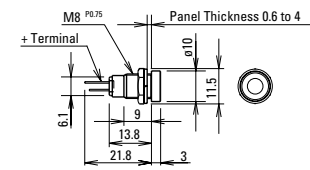


## ø8 IPL1-88

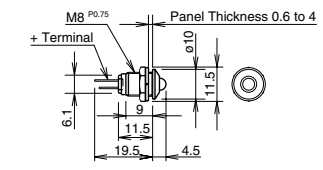


## ø8 IPL1-89

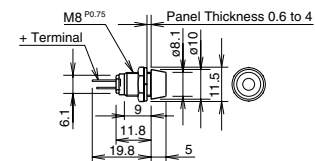


## ø6 IPL1-67

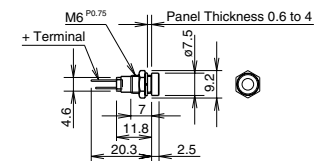

## ø6 IPL1-68

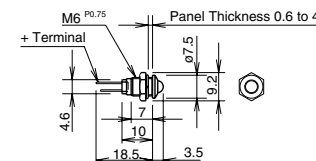

## ø6 IPL1-69

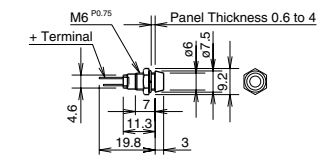

OT Touchscreens

PLCs

Automation Software

Power Supplies

Sensors


Communication

Barriers

## Illuminated Pushbuttons


## ø30 EB3P-LBAN211/LBA0N211

Terminal cover: N-VL4 (2 pcs.) (sold separately)

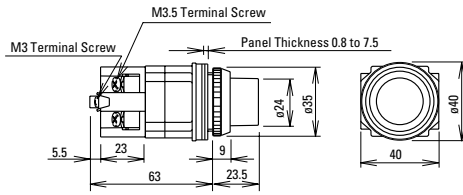


## ø30 EB3P-LBAVN311-R

Terminal cover: N-VL4 (2 pcs.) (sold separately)

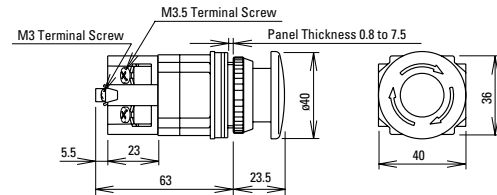


## ø22 EB3P-LBAW211/LBA0W211

Terminal cover attached.

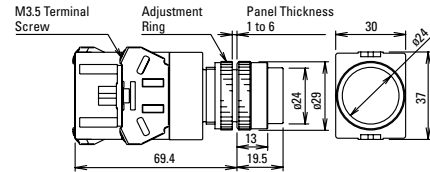


## ø22 EB3P-LBAVW411-R

Terminal cover attached.

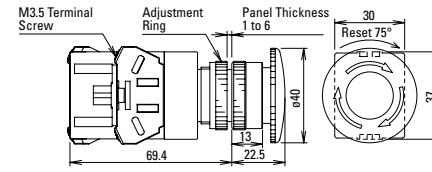


## ø22 EB3P-LBH1W110/LBHA1W110

Terminal cover attached.

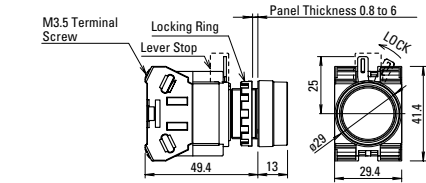


## ø22 EB3P-LBL1W1C2/LBLA1W1C2

Terminal cover: LW-VL2M (sold separately)

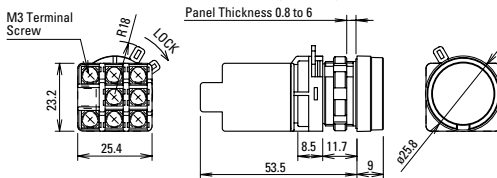

## ø22 EB3P-LBL2W1C2/LBLA2W1C2

Terminal cover: LW-VL2M (sold separately)

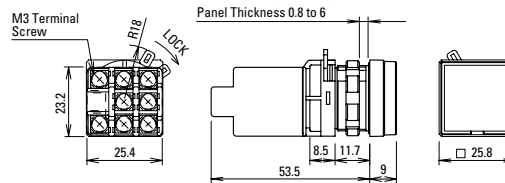


All dimensions in mm.

## Illuminated Selector Switches


## ø30 EB3P-LSAN211/EB3P-LSAN320

Terminal cover: N-VL4 (2 pcs.) (sold separately)

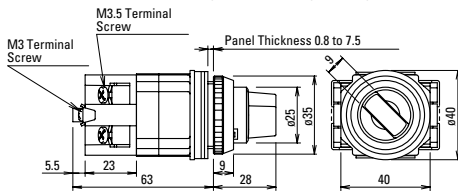


## ø22 EB3P-LSAW\*\*\*

Terminal cover attached

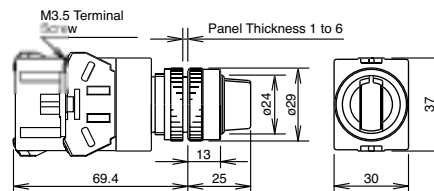


## ø22 EB3P-LSHW211/EB3P-LSHW320

Terminal cover attached

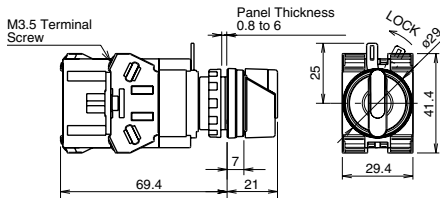

## ø22 EB3P-LSL1W2C2/EB3P-LSL3W3C2


Terminal cover: LW-VL2M (sold separately)

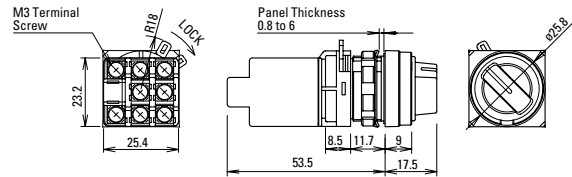


## Buzzer

## ø30 EB3P-ZUN12CN/ZUN12FN

Terminal cover: AZ-VL5 (sold separately)

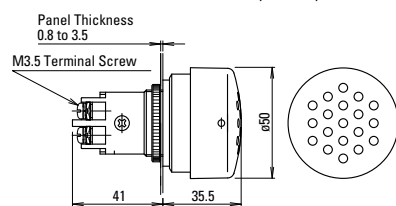

## EB9Z-LDS1

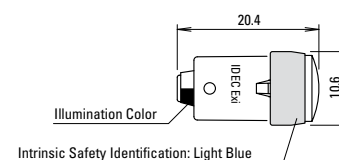

Illumination color is marked on the terminal.

## Polarity Identification


### Pilot Lights/Illuminated Pushbuttons/Illuminated Selector Switches

Positive terminal: X1  
Negative terminal: X2

### Miniature Pilot Lights

Positive terminal: Long pin terminal  
Negative terminal: Short pin terminal

Pin Terminals




A light blue marking is indicated on the negative terminal side to identify intrinsically safe usage.

### Buzzer


Positive terminal: +  
Negative terminal: -

### LED Lamp



### Lamp Test

When checking the lamp lighting without using the EB3L discrete output barrier, first make sure that the atmosphere is free from explosive gases. Connect a 12V DC power supply and a protection resistor of 1 kΩ in series to turn on the pilot light.

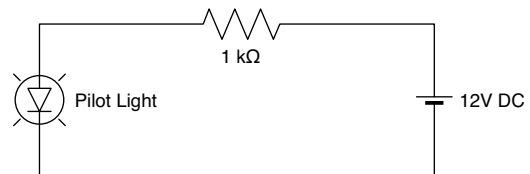

## Precautions for Operation


### Installation of EB3L Discrete Output Barriers

1. The EB3L can be installed in any direction.
2. Install the EB3L discrete output barrier in a safe area (non-hazardous area) in accordance with intrinsic safety ratings and parameters. To avoid mechanical shocks, install the EB3L in an enclosure which suppresses shocks.
3. When installing or wiring the EB3L, prevent electromagnetic and electrostatic inductions in the intrinsically safe circuit. Also prevent the intrinsically safe circuits from contacting with another intrinsically safe circuit and any other circuits.

Maintain at least 50 mm clearance, or provide a metallic separating board between the intrinsically safe circuit and non-intrinsically safety circuit. When providing a metallic separating board, make sure that the board fits closely to the enclosure (top, bottom, and both sides). Allowable clearance between the enclosure and board is 1.5 mm at the maximum.


The clearance of 50 mm between the intrinsically safe circuit and non-intrinsically safe circuit may not be sufficient when a motor circuit or high-voltage circuit is installed nearby. In this case, provide a wider clearance between the circuits referring to 6. (3) "Minimum Parallel Distance between the Intrinsically Safe Circuit and Other Circuits."

4. In order to prevent contact between intrinsically safe circuits and non-intrinsically safe circuits, mount EB3L units with terminals arranged in the same direction.

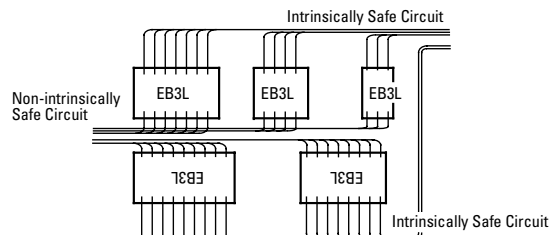


5. Maintain at least 6 mm (or 3 mm according to IEC60079-11: 1999) clearance between the terminal of intrinsically safe circuit and the grounded metal part of a metal enclosure, and between the relay terminal block of an intrinsically safe circuit and the grounded metal part of a metal enclosure.
6. For installing the EB3L, mount on a 35-mm-wide DIN rail or directly on a panel using screws. The EB3L can be installed in any direction. Make sure to install securely to withstand vibration. When mounting on a DIN rail, push in the clamp completely. Use the BNL6 end clips on both sides of the EB3L to prevent from moving sideways.
7. Excessive extraneous noise may cause malfunction and damage to the EB3L. When extraneous noise activates the voltage limiting circuit (thyristor), remove the noise source and restore the power.

### Panel Cut-out Pilot Lights/Illuminated Pushbuttons/Illuminated Selector Switches/Buzzers

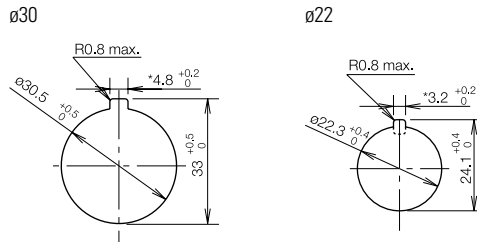

### Miniature Pilot Lights

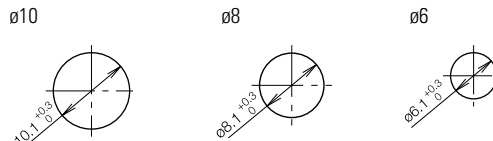

\* The 4.8 or 3.2 recess is needed only when using an anti-rotation ring or a nameplate with an anti-rotation projection.  
EB3P-LHW does not have an anti-rotation groove.

All dimensions in mm.



### Terminal Wiring

1. Using a  $\phi 5.5$  mm or smaller screw driver, tighten the terminal screws (including unused terminal screws) to a torque of 0.6 to 1.0 N·m (recommended value).
2. Make sure that IP20 is achieved when wiring. Use insulation tubes on bare crimping terminals.
3. To prevent disengaged wires from contacting with other intrinsically safe circuits, bind together the wires of one intrinsically safe circuit.
4. When the adjacent terminal is connected to another intrinsically safe circuit, provide an insulation distance of at least 6 mm.

### Signal Input

1. Connect the EB3L to the switches or output equipment which have a low leakage current (0.1 mA maximum).
2. The EB3L is equipped with power supply. Do not apply external power to the EB3L.
3. When connecting the EB3L's of connector type in parallel, make sure that the same power supply is used. When using C1 and C2 terminals to supply power to outside equipment, maintain the current at 50 mA maximum.

### Power Voltage

1. Do not apply an excessive power voltage, otherwise the EB3L may be damaged.
2. The EB3L of AC power type may operate at a low voltage (approx. 20V).

### Pilot Lights, Illuminated Switches, and Buzzers in the Hazardous Area

1. EB3P and IPL1 units shown on page 267 can be used with the EB3L. Buzzers cannot be connected in common wiring.
2. Install the EB3P and IPL1 units on enclosures of IP20 or higher protection. Use a metallic enclosure with magnesium content of 7.5% or less (steel and aluminum are acceptable).
3. When wiring, make sure of correct polarities of the EB3P and IPL1.
4. Certification mark is supplied with the units. Attach it on the visible area of the EB3P or IPL1 (for Japan application).
5. EB3P (except for buzzers) and IPL1 illuminated units, which are simple apparatuses in accordance with relevant standards of each country, can be installed in the hazardous area and connected to the EB3L located in the safe area.
6. When connecting illuminated switches to the EB3L discrete output barrier and the EB3C discrete input barrier, a maximum of 16 channels can be connected in common wiring.

### Wiring for Intrinsic Safety

1. The voltage applied on the general circuit connected to the non-intrinsically safe circuit terminals of the EB3L discrete output barrier must be 250V AC, 50/60Hz (UL rating: 125V AC 50/60Hz), or 250V DC (UL rating: 125V DC) at the maximum under any conditions, including the voltage of the power line and the internal circuit.
2. When wiring, take into consideration the prevention of electromagnetic and electrostatic charges on intrinsically safe circuits. Also, prevent intrinsically

safe circuits from contacting with other circuits.

3. The intrinsically safe circuits must be separated from non-intrinsically safe circuits. Contain intrinsically safe circuits in a metallic tube or duct, or separate the intrinsically safe circuits referring to the table at right.

Note: Cables with a magnetic shield, such as a metallic sheath, prevent electromagnetic induction and electrostatic induction, however, a non-magnetic shield prevents electrostatic induction only. For non-magnetic shields, take a preventive measure against electromagnetic induction.

Finely twisted pair cables prevent electromagnetic induction. Adding shields to the twisted pair cables provides protection against electrostatic induction.

Voltage and Current of Other Circuits	Over 100A	100A or less	50A or less	10A or less
Over 440V	2000	2000	2000	2000
440V or less	2000	600	600	600
220V or less	2000	600	600	500
110V or less	2000	600	500	300
60V or less	2000	500	300	150

Note: Above chart is applicable under TIS standards only.

### Minimum Parallel Distance between the Intrinsically Safe Circuit and Other Circuits (mm)

1. When identifying intrinsically safe circuits by color, use light blue terminal blocks and cables.
2. When using two or more EB3L's to set up one intrinsically safe circuit in the common wiring configuration, interconnect two neutral terminals (N1 through N10) on each EB3L between adjacent EB3L's in parallel.
3. Make sure that the power of the EB3L, pilot lights, and other connected units are turned off before starting inspection or replacement.
4. When wiring the intrinsically safe circuit, determine the distance to satisfy the wiring parameters shown below. Note that parameters are different between separate wiring and common wiring and depend on the connected units, such as pilot lights, illuminated pushbuttons, and buzzers.
  - a) Wiring capacitance  $C_w \leq C_o - C_i$   
 $C_o$ : Maximum external capacitance of the EB3L  
 $C_i$ : Internal capacitance of the connected unit
  - b) Wiring inductance  $L_w \leq L_o - L_i$   
 $L_o$ : Maximum external inductance of the EB3L  
 $L_i$ : Internal inductance of the connected unit
  - c) Wiring resistance  $\leq R_w$   
 $R_w$ : Allowable wiring resistance
  - d) Allowable wiring distance D (km) is the smallest value of those calculated from the capacitance, inductance, and resistance.

$D \leq C_w/C$        $C$  (nF/km): Capacitance of cable per km  
 $D \leq L_w/L$        $L$  (mH/km): Inductance of cable per km  
 $D \leq R_w/2R$        $R$  ( $\Omega$ /km): Resistance of cable per km

Note: For the details of wiring the intrinsically safe circuits, refer to a relevant test guideline for explosion-proof electric equipment in each country.

### Safety Precautions

Do not use the EB3C Discrete Input Barrier and EB3L Discrete Output Barrier for other than explosion protection purposes.

Read the user's manual to make sure of correct operation before starting installation, wiring, operation, maintenance, and inspection of the EB3C Discrete Input Barrier and EB3L Discrete Output Barrier.




## General Information

### What is Explosion Protection?

#### Explosion Mechanism

For an explosion to occur, both hazardous atmosphere (mixture of explosive gas/vapor and air) and ignition source from electrical equipment must exist. The first step for explosion prevention is to prevent the three factors (explosive gas/vapor, air, and ignition source) from existing at the same time.

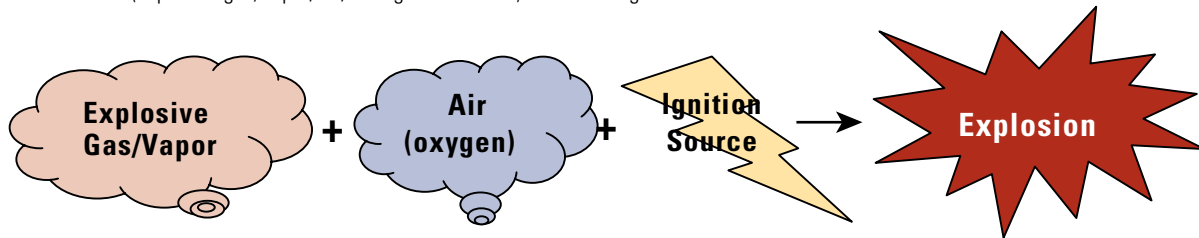

Ignition source: Electrical equipment which originates electrical sparks or has a high temperature, capable of causing ignition in a hazardous atmosphere.

Explosion protection types:

1. Separation of explosive gas/vapor and ignition source
  - Flameproof explosion protection
  - Pressurized explosion protection
2. Low power on ignition source → Intrinsically safe explosion protection

#### Classification of Hazardous Areas

- Required when selecting explosion protection electrical equipment and wiring methods.
- Determined by user.
- Hazardous areas are classified depending on the frequency of the occurrence of hazardous atmosphere.


#### IEC Classification

Zone 0: Where hazardous atmosphere may exist for 1,000 hours or longer per year.

Zone 1: Where hazardous atmosphere may exist for 10 to 1,000 hours per year.

Zone 2: Where hazardous atmosphere may exist for less than 1 hour per year.


#### Gasoline Tank Example

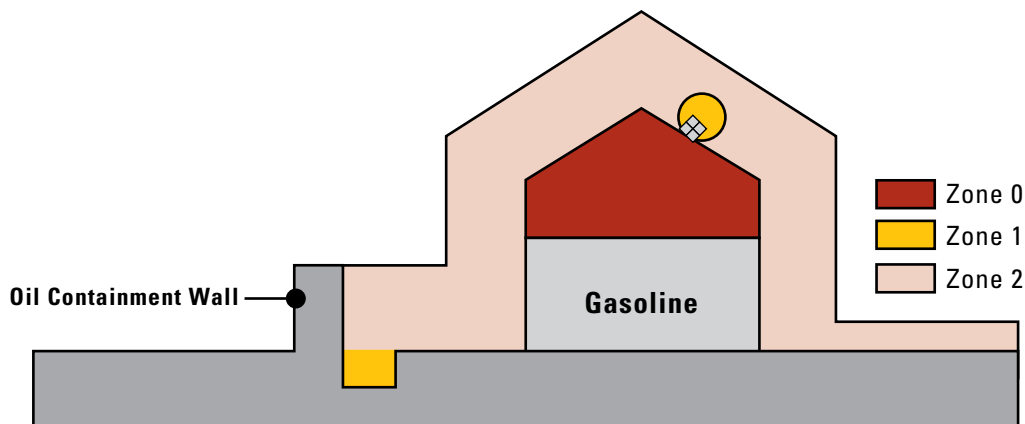

## Explosion Protection Types

### Intrinsically Safe Structure

- Structure in which voltage and current are limited so that no sparks, arc, and thermal effect produced by electric equipment (switch, pilot light, etc) in hazardous areas are capable of causing ignition of explosive gas/vapor.

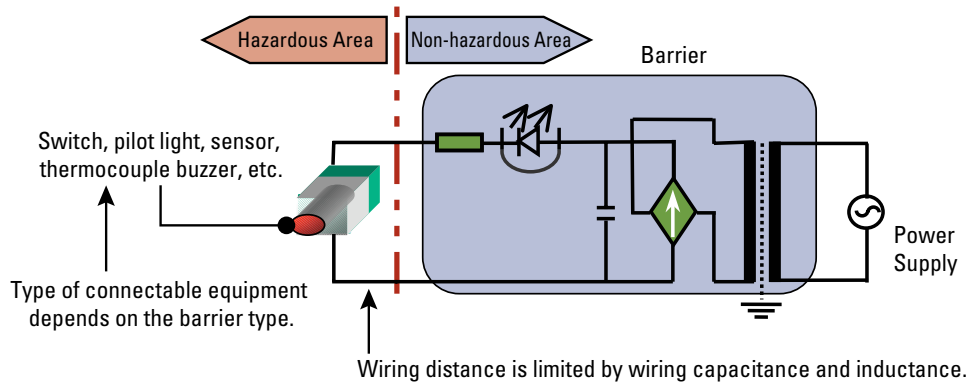

### Features:

- Barrier is installed in non-hazardous area, and is connected to the switches or pilot lights in hazardous area.
- The intrinsically safe system can be used in zone 0.
- Because voltage and current to the electric equipment are limited, the variety of devices that can be connected to the barrier is restricted.
- Wiring is required between hazardous and non-hazardous areas.
- Grounding (grounding resistance 10Ω max.) may be required (EB3C, EB3L do not require grounding).

**Grounding** - The procedure to achieve required resistance value by inserting a grounding wire into a hole in the ground and furnishing the surrounding with material of superior electrical conductivity.

**Non-insulated barrier (Zener barrier):** grounding resistance 10Ω max.

- While the voltage difference between the circuits is limited in Zener barriers, the voltage difference between the circuits and grounding is unlimited. When a short-circuit occurs between the circuits and ground, high voltage/current may be generated in the circuits, causing a possible explosion. The OV line of circuits, therefore, must be provided with grounding (resistance 10Ω max.) so that the voltage/current can be shunted to the ground.

**Insulated barrier:** grounding resistance 100Ω max.

- Intrinsically safe and non-intrinsically safe parts are electrically isolated by an isolation transformer. If a sufficient isolation distance is not provided on the isolation transformer, however, the transformer may short-circuit between primary and secondary when an abnormal voltage occurs. This may generate high voltage/current in the intrinsically safe circuit, causing a possible explosion. A transformer with metallic isolator must be used between primary and secondary, and grounding (resistance 100Ω max.) must be provided.


### Difference between NI (Non-incendive) & IS (Intrinsic Safety)

#### Standard

- NI: Installed in areas that are Zone 2 hazardous locations.
- IS: Installed in areas that are non-hazardous.


#### Advantages & Disadvantages

- NI: Small and inexpensive. Devices connected with NI are also installed only in the Zone 2 area.
- IS: Small but more expensive. Devices connected with IS can be used in the Zone 0, 1 and 2 areas (all zones).

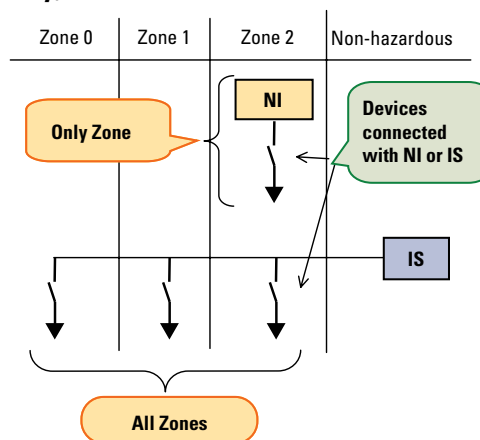


## Structure

NI Structure

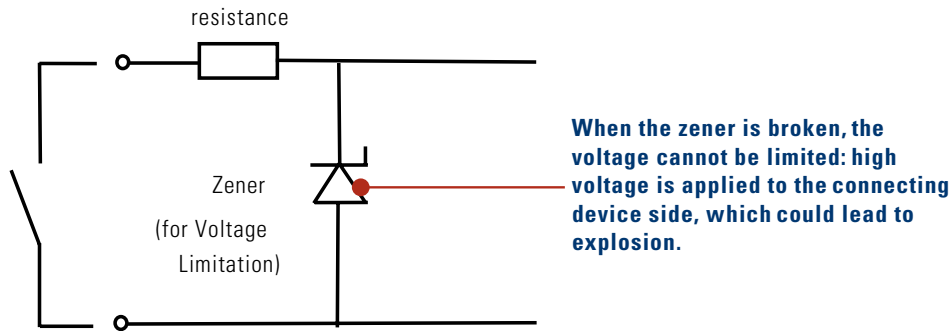

IS Structure

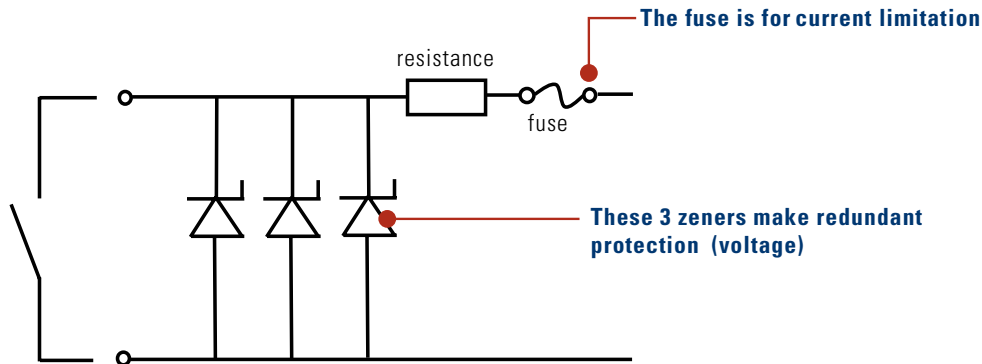


Note : Instead of zeners, thyristors are used in EB3C for better energy efficiency.

## Explosion Protection Marking

Gas is categorized into groups by explosiveness and ignition temperature.

Technical standard: Determines the gas type which can be used with the apparatus.

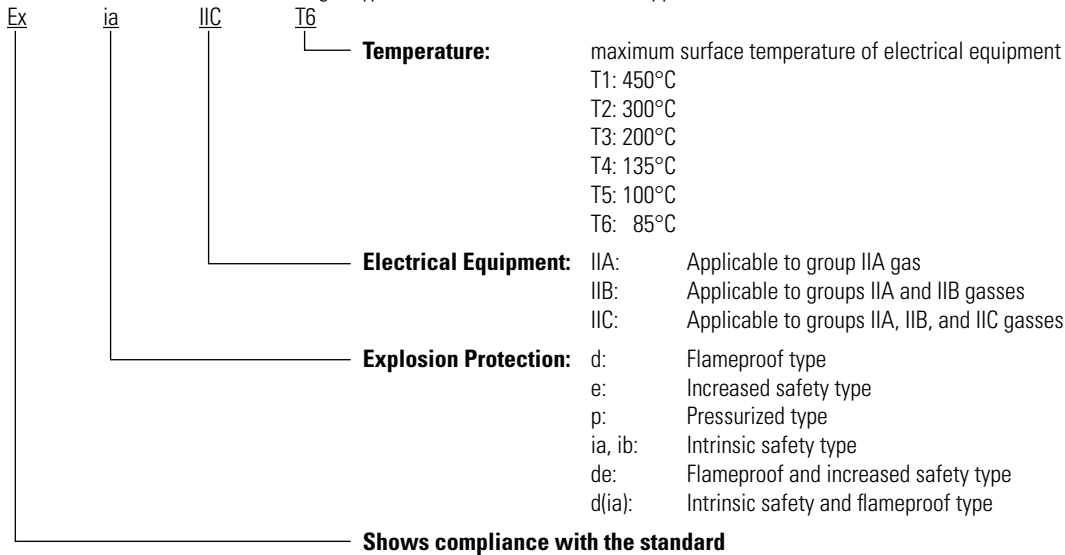

Examples: ExdIIBT4, ExeIICT4, ExlIBT4, ExaIICT5

## EB3C/EB3L Features

## Small and lightweight

EB3C (10-circuit)	Weight: 380g Dimensions: 171.5 L × 75 W × 77.5 H (mm)	<ul style="list-style-type: none"> <li>• Plastic housing</li> <li>• Small system design</li> </ul>
EB3L (10-circuit)	Weight: 360g Dimensions: 171.5 L × 75 W × 77.5 H (mm)	

## No grounding required: less labor, less cost

No explosion protection grounding.

Isolation transformer is used. All isolations – not only between primary and secondary, but also cores and bobbins – are reinforced.



No isolator = No grounding

No electrical equipment grounding.

Power supply part: Electric shock is prevented with reinforced isolation. Conforms to IEC standard.

Output part: The small power & EMC design requires no grounding. Conforms to IEC switch output standard.

Shield wire treatment

Shield wires of intrinsically safe circuits are grounded to the panel in non-hazardous area, and not connected to the N terminal on the barrier.

## Common Type and Connector Type

1. Common type → For 8 and 16 circuits. Easy connection to PLC.
2. Connector type
  - Flat cable connection between non-intrinsically safe part and PLC.
  - Connectable to IDEC's FC5A, and FC4A.

## Standards

1. CE  
Conforms to EMC directive and LVD.  
EMC directive:  
Electromagnetism generated by the barrier does not affect other communication equipment. Also, electromagnetism generated by other communication equipment does not affect the barrier.  
LVD (Low Voltage Directive):  
For rated voltages 50 to 1000V AC, 75 to 1500V DC.
2. ATEX  
Adopted by EU, this directive covers electrical and mechanical equipment and protective systems, which may be used in potentially explosive atmospheres (Europe). EN50014 series is adopted.
3. FM (Factory Mutual Approval)  
A private US certification organization for waterproof and intrinsic safety. Widely recognized for more intrinsic safety than UL.
4. CSA (Canadian Standards Association)  
A Canadian certification organization for electrical equipment.
5. NK: Class NK (Nippon Kaiji Kyokai)  
Required for ships with Japanese ship registration.
6. Underwriters Laboratories (UL) - A US certification agency for all electrical and hazardous location products.

## Less labor

1. Finger-safe spring-up terminal  
The finger-safe, captive spring-up terminals prevent electric shock (IP20), and make installation easy. No screw loss.
2. Universal voltage  
100 to 240V AC (UL rating 100 ~ 120VAC).
3. Installation  
Direct and DIN-rail mountable.

**EB3 series: Screws cannot be touched by fingers even when loosened.**

## Switches connectable to EB3C

Switches which are configured only with mechanical contacts (dry contacts) can be connected to the EB3C.

Pushbutton, selector, cam, toggle, limit, micro, reed, foot, pressure, and temperature switches can be used.



Note: Contact rating must be 13.2V, 14.2 mA minimum. Contact material such as silver oxide cadmium and silver tungsten may cause conduction failure at 10 mA due to the film generated on the surface.

## Equipment connectable to EB3L

Common wiring: Only EB3P-L type pilot lights, which have been approved, can be connected to the EB3L discrete output barrier.

Separate wiring: No approval is required for pilot lights and buzzers to be connected to the EB3L discrete output barrier. However, users must make sure that the temperature rise of the equipment is below the rated value with the current and voltage supplied from the discrete input barrier. Also take the ratings of intrinsically safe circuit into consideration. IDEC's EB3P-L type pilot light lights and EB3P-Z type buzzers satisfy the ratings.

EB3P-L Pilot light: ø22 and ø30, a total of 78 types

- Super LED installed
- Lens colors: amber, blue, green, red, white, and yellow
- Accessories and maintenance parts are the same as standard control units. See IDEC's control units catalogs.

IPL1 Miniature pilot light: ø6, ø8, and ø10, a total of 40 types

- Low price
- Illumination colors: amber, green, red, white, and yellow

EB3P-Z buzzer: Continuous and intermittent sound, ø30 mounting hole, terminal block type

- Degree of protection: IP20
- Common wiring is not available due to high inductance value.
- Approved by TIIS only

ø30: APN, UPQN equivalent  
ø22: APW, HW,LW,UPQW equivalent



When connecting one buzzer and 15 pilot lights to EB3L-S16CSD, do not connect the negative lines of buzzer and pilot lights in common. Connect the buzzer and pilot lights to the barrier using separate lines (15 pilot lights can be wired with one common line).

## Connecting Illuminated Switches

Made possible with the combination of EB3L and EB3C.

### User benefits

- Flexibility of control panel design  
Explosion protected panels can be designed in a similar manner to non-explosion protected panels (non-explosion protected panels can be used as explosion protected panels without any changes).
- Control panel becomes smaller.

Connectable illuminated switch: 134 types

<b>EB3P-LB</b> Illuminated Pushbutton Switch	{ ø30: ALN2 equivalent ø22: ALW2, HW, LW equivalent
<b>EB3P-LS</b> Illuminated Selector Switch	{ ø30: ASLN equivalent ø22: ASLW, HW, LW equivalent

Super LED installed.

Lens color: amber, blue, green, red, white, yellow

### Connection Method

#### 1. Difference between EB3C and EB3L

EB3C: ON/OFF output signals to other equipment.

→ Connection to PLC's inputs.

EB3L: ON/OFF input signals to pilot lights and buzzers.

→ Connection from PLC's outputs.

#### 2. Sink and Source

Available combination: Sink Output + Source Input or Source Output + Sink Input. Sink output (source input) is mainly adopted in Japan (Europe: source output).

### Other information

- Up to 16 channels, including both pilot lights and contacts, can be connected in common wiring.
- Connect the common wires of pilot lights and contacts separately to the N terminals of each barrier.
- Use two wires to connect the common terminals (N terminals) EB3C and EB3L barriers.
- Accessories and maintenance parts are the same as the standard control units. See IDEC's control units catalogs for details.

## Safety Precautions

### Electrostatic protection: Prevention of fire ignition and explosion caused by electrostatic charges.

- As required by IEC60079-11, limit the exposed surface of plastic equipment (switch, pilot light) installed in hazardous areas.
- 20 cm<sup>2</sup> max. for IIC gas atmosphere.
- 100 cm<sup>2</sup> max. for IIB and IIA gas atmosphere.
- When the surface area of other than operating parts exceeds the limit, attach a caution plate.
- Pushbutton, knob, or other parts which are frequently touched by operators.

### EB3C Separate and Common Types



#### 1. Separate Wiring Type

The output circuit is isolated for each channel. Both sink and source outputs can be connected.

#### 2. Common Wiring Type

The output circuit is not isolated from each other and uses common terminal C. Sink and source outputs are available on different modules.

## Sink/Source Definition

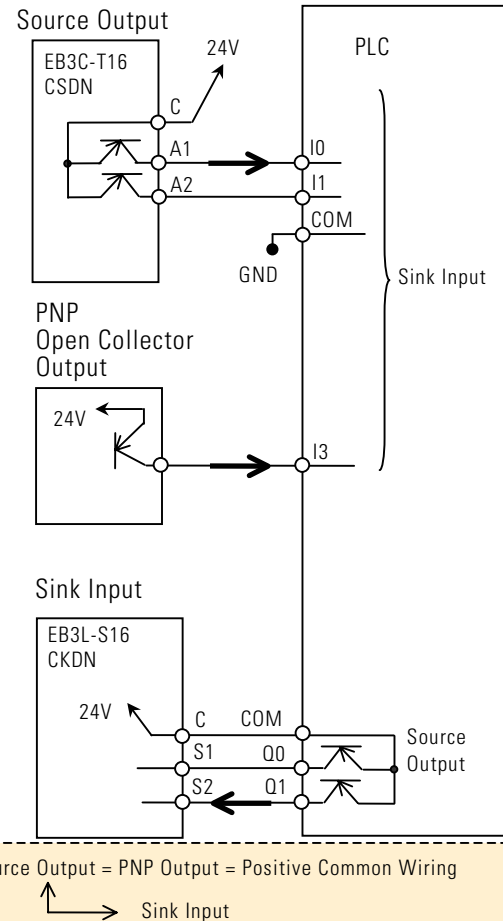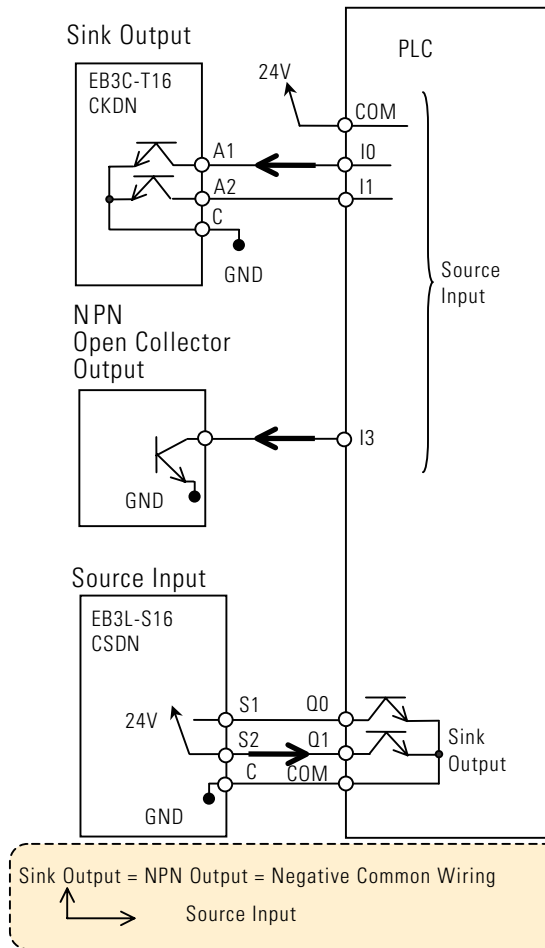

## Relay Terminal Block

When connecting a discrete input barrier to the switches and pilot lights installed in hazardous area, use a relay terminal block.



A relay terminal block can be eliminated when using EB3C and EB3L, as these barriers are considered as relay terminal blocks.

## Cable Extension and Intrinsic Safety Parameter

- For wiring between the barrier and the switches and pilot lights installed in hazardous area, use a cable of 2.0 mm<sup>2</sup>. The cable can be extended up to approximately 1 km.
- For EB3L of common wiring type, use a cable of 2.0 mm<sup>2</sup>. The cable can be extended up to approximately 600 m. Longer cables cause dim LED lighting.



Make sure that wiring parameters (inductance, capacitance, resistance) do not exceed the maximum limit.

## Noise Countermeasure

- The LED connected to the EB3L may blink due to noises.
- Check the wiring so that noise is not imposed on the EB3L (eg. separation from power line).
- Noise can be avoided also by inserting a noise filter for AC line into the barrier's power input part.

Recommended noise filters:

TDK-Lambda

RSEL-2002W

RSEL-2003W

RSEL-2006W

RSEL-2002A

RSEL-2003A

RSEL-2006

ZCB2203-11 => RSEL-2003A

ZCB2206-11 => RSEL-2006A

Schaffner

FN670-3/06